

**DRAFT**

**New Zealand Standard**

---

**Draft number: PAS  
5210**

---

**Public comment draft**

Draft	Date
PC Draft	24 April 2024

**Committee: P5210**

---

DO NOT USE THIS DRAFT AS A STANDARD –

IT MAY BE ALTERED BEFORE FINAL PUBLICATION

---

Standards New Zealand

---

PO Box 1473, Wellington 6140

---

## Technical Advisory Group representation

This publicly available specification was prepared by the P5210 High Temperature Heat Pumps Technical Advisory Group (TAG). Members of the TAG were appointed by the New Zealand Standards Executive under the Standards and Accreditation Act 2015.

The TAG consisted of representatives of the following nominating organisations:

Carbon and Energy Professionals New Zealand

Energy Efficiency Conservation Authority

Energy New Zealand

Institute of Refrigeration Heating and Air Conditioning Engineers of New Zealand Inc.

Massey University

Ministry for the Environment

New Zealand Green Building Council

New Zealand National Committee of the International Institute of Refrigeration

Solar Association of New Zealand

Western Institute of Technology

WorkSafe New Zealand

## Acknowledgements

Standards New Zealand gratefully acknowledges the contribution of time and expertise from all those involved in developing this specification.

## Copyright

This specification is Crown copyright administered by the New Zealand Standards Executive. You may not reproduce any part of it without prior written permission of the New Zealand Standards Executive, unless your actions are permitted by the Copyright Act 1994.

We will vigorously defend the copyright in this specification. Your unauthorised use may result in a fine of up to \$10,000 for every infringing copy (up to a maximum of \$150,000 for the same transaction and other specified offences) or imprisonment of up to 5 years. If the breach is serious, we may also seek additional damages from you as well as injunctive relief and/or an account of profits.

Published by Standards New Zealand, PO Box 1473, Wellington 6140. Telephone: (03) 943 4259, Website: [www.standards.govt.nz](http://www.standards.govt.nz).

## Single User PDF Terms & Conditions

You have material which is subject to strict conditions of use. Copyright in this material is owned by the New Zealand Standards Executive. Please read these terms and conditions carefully, as in addition to the usual range of civil remedies available to Standards New Zealand on behalf of the New Zealand Standards Executive for infringement of copyright, under New Zealand law every person who infringes copyright may be liable to a fine of up to \$10,000 for every infringing copy or imprisonment of up to 5 years, or a fine of up to \$150,000 or imprisonment not exceeding 5 years.

You have access to a single-user licence to read this non-revisable Adobe Acrobat PDF file and print out and retain ONE printed copy only.

We retain title and ownership of the copyright in this PDF file and the corresponding permitted printed copy at all times.

Under this license use of both the PDF file and the single permitted printed copy of this PDF file you may make are restricted to you. Under no circumstances are you permitted to save, sell, transfer, or copy this PDF file, the one permitted printed copy of this PDF file, or any part of either of them.

You undertake that you will not modify, adapt, translate, reverse engineer, decompile, disassemble or create derivative works based on any of the downloaded PDF file, nor will you merge it with any other software or document, even for internal use within your organization.

Under no circumstances may this PDF file be placed on a network of any sort without our express permission.

You are solely responsible for the selection of this PDF file and any advice or recommendation given by us about any aspect of this PDF file is intended for guidance only and is followed or acted upon entirely at your own risk.

We are not aware of any inherent risk of viruses in this PDF file at the time that it is accessed. We have exercised due diligence to ensure, so far as practicable, that this file does not contain such viruses.

No warranty of any form is given by us or by any party associated with us with regard to this PDF file, and you accept and acknowledge that we will not be liable in any way to you or any to other person in respect of any loss or damage however caused which may be suffered or incurred or which may arise directly or indirectly through any use of this PDF file.

Regardless of where you were when you received this PDF file you accept and acknowledge that to the fullest extent possible you submit to New Zealand law with regard to this licence and to your use of this PDF file.

**DZ PAS 5210:2024**

New Zealand Publicly  
Available Specification

# **High-temperature heat pumps**

**Superseding SNZ PAS 5210:2021**

## Contents

1	General .....	1
1.1	Scope.....	1
1.1.1	Inclusions.....	1
1.1.2	Exclusions.....	1
1.2	Key concepts .....	1
1.3	Defined terms .....	1
1.4	Abbreviations .....	4
1.5	Notation .....	6
2	Introduction to heat pumps .....	7
2.1	What a high-temperature heat pump is .....	7
2.2	Reasons to consider a high-temperature heat pump .....	8
2.3	Advantages of high-temperature heat pumps .....	8
2.4	Limitations of high-temperature heat pumps .....	8
2.5	Core technologies used in heat pumps .....	9
2.5.1	Capacity and speed control .....	9
2.5.2	Compressor type .....	9
2.5.3	Liquid-injection cycle .....	10
2.5.4	Vapour-injection (economised) cycle.....	10
2.5.5	Metering or throttling devices .....	10
2.5.6	Motor types.....	11
2.5.7	Defrost methods .....	11
3	Domestic Heat-pump Water Heaters.....	12
3.1	General .....	12
3.2	Technologies available .....	12
3.2.1	Integrated 'all in one' units .....	12
3.2.2	Split units .....	12
3.3	Heat-exchangers for potable-water systems.....	14
4	Refrigerants for domestic applications.....	15
4.1	General .....	15
4.2	Environmental and safety issues.....	15
4.3	Refrigerant leaks.....	15
4.4	Temperature constraints.....	15
5	Operational considerations for domestic heat pumps .....	16
5.1	General .....	16
5.2	Thermal stratification .....	16
5.3	Legionella control.....	16
5.4	Controls .....	17
5.5	Factors that affect performance and durability .....	17
5.6	Compliance and standards.....	17
5.7	Performance verification.....	18
5.8	Replacement of an instantaneous gas hot-water heater.....	18
5.9	Replacement of an internal electric water heater .....	18
6	Specification for domestic heat-pump water heaters.....	19
7	Commercial high-temperature heat pumps .....	20
7.1	General .....	20
7.2	Refrigerants for commercial applications .....	20
7.2.1	General .....	20
7.2.2	Environmental and safety issues.....	20
7.2.3	Refrigerant leaks.....	20
7.3	Temperature .....	20
7.3.1	Temperature of the heat source and heat sink, and the return-water temperature.....	20
7.3.2	Temperature constraints .....	21
7.4	Direction of technological development.....	21
7.5	Electrical supply and controls .....	22
7.5.1	Electrical supply .....	22
7.5.2	Controls .....	22

7.6	Factors affecting durability and lifetime .....	22
7.7	Compliance and standards .....	23
7.7.1	Electrical safety .....	23
7.7.2	Refrigerants .....	23
7.7.3	Heat-transfer medium .....	24
7.7.4	Physical protection .....	24
7.7.5	Contamination of potable-water supplies .....	24
7.7.6	Seismic design .....	24
8	Commissioning .....	25
8.1	General .....	25
8.2	Compliance and standards .....	26
8.3	Remote monitoring .....	26
8.3.1	Capability to connect .....	26
8.3.2	Remote switching .....	26
8.3.3	Alarm reporting .....	26
8.3.4	Remote monitoring .....	26
8.3.5	Connectivity security and access .....	27
8.4	Performance assessment and verification .....	27
8.4.1	Modelling and simulation .....	27
8.4.2	Daily heating demand .....	27
8.5	In-situ performance assessment .....	28
8.5.1	Carbon accounting .....	28
8.6	Specification .....	28
9	Application: Commercial potable-water heaters .....	29
9.1	General .....	29
9.2	Technologies available .....	29
9.2.1	Single-pass units .....	29
9.2.2	Multi-pass units .....	29
9.3	Tank connections .....	30
9.4	Reticulated systems .....	30
9.5	Heat-exchangers .....	30
9.6	Multi-residential heated-water systems .....	31
9.7	Performance assessment .....	31
9.8	Determining demand .....	31
10	Application: Space heating .....	33
10.1	Commercial space-heating systems .....	33
10.2	Refrigerants .....	33
10.3	Temperature .....	33
10.3.1	Temperature of the heat source and heat sink, and the return-water temperature .....	33
10.4	Operational considerations .....	33
10.5	Pipe size restrictions .....	34
10.6	Whole-of-life analysis .....	34
10.7	Performance standards .....	34
10.8	Temperature differential .....	34
10.9	Thermal storage .....	34
10.10	Fluid distribution .....	34
10.11	Minimum temperature for space heating .....	34
10.12	Pump efficiency .....	34
10.13	Fluid-distribution pipe insulation .....	34
10.14	Retrofit constraints .....	35
10.15	Provision of cooling .....	35
10.16	Scope and benefits of advanced controls .....	36
10.16.1	Considering the installation as a complete system .....	36
10.16.2	Capacity control .....	36
10.16.3	Pump control .....	36
10.17	Estimation of required heating capacity .....	37
10.18	Compliance and standards .....	37

	10.19 Seasonal coefficient of performance .....	37
	10.20 Performance monitoring .....	38
	10.21 Case study: George Manning Lifecare .....	38
1 1	Application: Pool heating (commercial) .....	39
1 2	Application: Fresh-air tempering .....	39
1 3	Industrial process heat .....	40
	13.1 Process heating .....	40
	13.2 Space heating .....	40
	13.3 Heat recovery .....	40
	13.4 Technologies available .....	40
	13.4.1 Ammonia heat pumps .....	40
	13.4.2 CO <sub>2</sub> heat pumps .....	40
	13.4.3 Mechanical vapour recompression systems .....	41
	13.4.4 Technology direction .....	41
	13.5 Refrigerants .....	41
	13.5.1 General .....	41
	13.5.2 Environmental and safety issues .....	41
	13.5.3 Refrigerant leaks .....	42
	13.6 Temperature .....	42
	13.6.1 Temperature of the heat source and heat sink, and the return-water temperature .....	42
	13.6.2 Temperature constraints .....	42
	13.7 Determining demand .....	43
	13.8 Factors affecting performance and durability .....	43
	13.9 Compliance and standards .....	44
	13.10 Performance monitoring .....	44
	13.11 Performance benchmarking .....	44
	APPENDIX A – ADDITIONAL INFORMATION ON REFRIGERANTS .....	45
	APPENDIX B – MODIFICATION OF AS/NZS 5125 METHODOLOGY FOR HTHP GREATER THAN 15 KW .....	48
	APPENDIX C – CALCULATION OF CARNOT COP .....	49

## Referenced documents

Reference is made in this document to the following:

### New Zealand standards

NZS 4219:2009 Seismic performance of engineering systems in buildings

### Joint Australian/New Zealand standards

AS/NZS 3500:- - - Plumbing and drainage  
 Part 4:2018 Heated water services  
 AS/NZS 3820:2020 Essential safety requirements for electrical equipment  
 AS/NZS 4020:2018 Testing of products for use in contact with drinking water  
 AS/NZS 4234:2021 Heated water systems — calculation of energy consumption  
 AS/NZS 4692:- - - Electric water heaters  
 Part 1:2005 Energy consumption, performance and general requirements  
 AS/NZS 5125:2014 Heat pump water heaters – performance assessment  
 AS/NZS 5149:- - - Refrigerating systems and heat pumps – safety and environmental requirements  
 Part 1:2016 Definitions, classification, and selection criteria  
 Part 2:2016 Design, construction, testing, marking, and documentation  
 Part 3:2016 Installation site  
 Part 4:2016 Operation, maintenance, repair, and recovery  
 AS/NZS 60079:- - - Explosive atmospheres  
 Part 0:2019 Equipment – General requirements  
 AS/NZS 60335:- - - Household and similar electrical appliances – safety  
 Part 2.40:2023 Particular requirements for electrical heat pumps, air-conditioners, and dehumidifiers  
 AS/NZS ISO 817:2016 Refrigerants – designation and safety classification

### Australian standards

AS 1210-2010 Pressure vessels  
 AS 2971:2007 Serially produced pressure vessels

### British standards

EN 378 Refrigerating systems and heat pumps  
 EN 14511-1:2022 Air conditioners, liquid chilling packages and heat pumps for space heating and cooling and process chillers, with electrically driven compressors – Part 1: Terms and definitions  
 EN 16147:2017+A1:2022 Heat pumps with electrically driven compressors – Testing, performance rating and requirements for marking of domestic hot water units  
 BS EN 13445:- - - Unfired pressure vessels  
 Part 1:2014 General  
 PD 5500 Specification for unfired fusion welded pressure vessels

### International Organization for Standardization standards

ISO 19967:- - - Heat pump water heaters – Testing and rating for performance  
 Part 1:2019 Heat pump water heater for hot water supply  
 ISO 21978:2021 Air to water heat pumps – Testing and rating at part load conditions and calculation of seasonal coefficient of performance for space heating



## Other publications

American Society of Mechanical Engineers. *Boiler and pressure vessel code (BPVC)*, Section VIII: Rules for construction of pressure vessels, Division 1, 2019.

## New Zealand legislation

Approved Code of Practice for Pressure Equipment (Excluding Boilers) 2001

Climate Change Response (Zero Carbon) Amendment Act 2019

Electrical (Safety) Regulations 2010

Energy Efficiency (Energy Using Products) Regulations 2002

Health and Safety in Employment (Pressure Equipment, Cranes and Passenger Ropeways) Regulations 1999

New Zealand Building Code (NZBC)

Ozone Layer Protection Act 1996

## Websites

[www.legislation.govt.nz](http://www.legislation.govt.nz)

## Latest revisions

The users of this publicly available specification should ensure that their copies of the above-mentioned New Zealand standards are the latest revisions. Amendments to referenced New Zealand and joint Australian/New Zealand standards can be found on [www.standards.govt.nz](http://www.standards.govt.nz).

## Review of standards

Suggestions for improvement of this standard are welcomed. They should be sent to the National Manager, Standards New Zealand, PO Box 1473, Wellington 6140.

## Foreword

PAS 5210:2024 supersedes PAS 5210:2021. The 2021 version was focused on high temperature heat pumps used to provide reticulated hot water for heating in institutional settings, for example, radiators in schools or office buildings. The revision extends the applications to domestic hot water heaters, commercial users of hot water, and process heating (water, air, or other substances) in industry. The field of high temperature heat pumps is an area of active research and innovation, so the PAS has been updated with the latest information.

# 1 General

## 1.1 Scope

### 1.1.1 Inclusions

This PAS covers these areas:

- (a) Electrically driven, packaged heat-pumps that deliver a temperature greater than 50°C;
- (b) Issues for integrating commercial and industrial applications onto sites (such as, connectivity, advanced controls, thermal storage and heating distribution, parallel provision of cooling, electrical supply, and performance monitoring);
- (c) The range of available refrigerants;
- (d) WorkSafe New Zealand safety requirements; and
- (e) New installations and retrofit applications.

### 1.1.2 Exclusions

This PAS does not cover these areas:

- (a) Standard heating, ventilation, and air conditioning (HVAC) systems and other heat-pump applications that deliver temperatures less than 50°C;
- (b) Detailed installation advice; and
- (c) Heat-driven heat pumps (such as, absorption heat transformers or absorption heat pumps).

## 1.2 Key concepts

It is important to understand these concepts:

- (a) The coefficient of performance (COP) measures the efficiency of a high-temperature heat pump (HTHP). A HTHP system with a COP of 4 will provide 4 units of heat energy (kWh) for every unit of electricity consumed (kWh). The actual COP depends on the application and operating conditions;
- (b) Refrigerant is the fluid used in a sealed HTHP to absorb and reject heat. Some refrigerants have a greater environmental impact than others, in terms of their contribution to ozone depletion, global heating, or accumulated heat in the environment. Some refrigerants that have less impact on the environment are flammable or toxic. The type of refrigerant a HTHP uses is an important consideration when purchasing a system. Refer to section 3.3 for details of common HTHP refrigerants used in New Zealand; and
- (c) Site integration is the process of assessing commercial and industrial facilities, to establish the best HTHP system for its needs. Site integration should include a site visit, and a report that thoroughly investigates the best HTHP options.

## 1.3 Defined terms

For the purposes of this PAS, the following definitions apply:

### Carnot cycle

A thermodynamically ideal heat-pump cycle with no losses. It has the highest theoretically possible COP, given the heat source and sink temperatures. The Carnot cycle COP cannot be achieved in practice, but it sets a useful benchmark to measure actual heat-pump systems against

### Cascade system

A configuration that combines two or more heat pumps, with the heat sink of one heat pump acting as the heat source for the next in the cascade. The component heat-pump systems are sealed and may use different refrigerants. When used correctly, the final heat pump in the cascade can deliver a high temperature at its heat sink more efficiently, and with a lower temperature lift, than a single heat pump. A cascade system is not the same as a multi-stage system, which achieves a similar benefit in a different manner. A cascade system can also be used in environments where it is easier to isolate a refrigerant that has high safety requirements

### Coefficient of performance (COP)

The ratio of the amount of useful heating (plus useful cooling, in some cases) to the amount of input energy. System COPs, which are used in this PAS, are more comprehensive, but compressor-only COPs (these include only compressor-energy input) are often quoted to allow comparisons with alternative heating systems when the rest of the system is not fully specified. Compressor-only COPs are higher than system COPs

<b>Design condition(s)</b>	<p>An operating condition for which an HTHP is designed or selected. Design conditions include the amount of heating demand, and the temperatures of the heat sink and heat source</p> <p>The designer should know the most extreme operating condition. For an HTHP with an ambient-air heat source, this is typically the heating demand at the coldest expected ambient temperature. The HTHP should be able to operate at this extreme condition and deliver the required amount of heat</p> <p>The designer should also ensure that the HTHP can perform with high energy-efficiency (high COP) at normal operating conditions, which is how the HTHP will operate most often (normal operating conditions are additional design conditions). COP is less important at extreme operating conditions, as the HTHP is not operated in this configuration for long periods of time</p> <p>The seasonal coefficient of performance (SCOP) is a method of aggregating performance over different operating conditions rather than at a single design condition</p> <p>For some applications (such as, some industrial process-heating applications), extreme and normal operating conditions may be similar</p>
<b>Heat-exchanger</b>	<p>A device that exchanges heat between two fluids. In a heat pump, the evaporator and condenser, or equivalent components, are both heat-exchangers</p>
<b>Heat rejected</b>	<p>The heat transferred by the heat pump into the heat sink. The heat is rejected from the heat pump in the condenser, or equivalent</p>
<b>Heat sink</b>	<p>The medium that receives heat from the heat pump, via its condenser or equivalent</p>
<b>Heat source</b>	<p>The medium that supplies heat to the heat pump, via its evaporator or equivalent</p>
<b>Multi-pass</b>	<p>A heat-pump water heater that is coupled to a tank. It heats water from the base of the tank in small increments (typically 5K) and returns the heated water to the lower part of the tank. The water-flow rate through the condenser is high, and the temperature difference across the heat-exchanger is low</p>
<b>Pinch analysis</b>	<p>A technique to determine the most energy-efficient configuration of heat exchange between heating and cooling operations. It is most relevant for complex industrial sites that have multiple simultaneous heating and cooling needs</p>
<b>Primary and secondary fluid</b>	<p>Some systems distinguish between primary fluid (the refrigerant) and secondary fluid (another utility fluid that is heated at the heat sink). The secondary fluid is pumped to the application that it is used to heat. An example is a heat pump that is used to heat hot water that is then reticulated to radiators to heat the air space. In this example, the primary fluid is the refrigerant in the heat pump, the secondary fluid is the hot water, and application is the air in the room</p>

Do not confuse primary and secondary fluid, with the use of primary and secondary in a hydronic context

**Primary and secondary hydronic system**

In many heating systems, the utility fluid (usually hot water) can be configured in primary and secondary hydronic systems, or 'loops'. In this configuration, the primary hydronic system is a fixed flowrate pumped through the heat generator (such as, an HTHP) and returned – hot – to the hot-water tank. The secondary hydronic system is the hot water that is pumped from the hot-water tank, on a separate distribution circuit, to meet the heating demand. In some cases, the fluid heated in the primary hydronic system is separated from the secondary hydronic system by a heat-exchanger. In other cases, the fluids in the primary and secondary circuits mix

Do not confuse a primary and secondary hydronic system, with the use of primary and secondary in a refrigerant context

**Refrigerant**

The fluid that is circulated within a heat pump to convey heat from the heat source to the heat sink. It can be a liquid or a vapour at different points in the heat-pump system

**Seasonal coefficient of performance (SCOP)**

The annual average COP for a heat pump. The SCOP accounts for the COP varying throughout the year, as heating demand and operating conditions change. SCOP can be calculated as the sum of heat provided (kWh) over the year, divided by the sum of power consumption (kWh) over the year

The seasonal energy efficiency ratio (SEER) is the same concept as the SCOP, but SEER is used in the refrigeration industry for cooling applications

The heating seasonal performance factor is also sometimes used to quantify how much a heat-pump system's performance varies over a year. The heating seasonal performance factor uses different units to the SCOP, and the two should not be directly compared

**Single-pass heat pump**

A type of heat pump that heats the incoming water to the target temperature by passing it through the heat-exchanger(s) once. The heat pump uses pump speed or compressor speed, or a combination of both, to maintain a near-constant supply-water temperature. It returns the heated water to near the outlet of the storage tank. If the heat pump is part of a closed loop, it can be tankless

**Single stage/multi-stage**

The configuration of a heat pump's mechanical vapour-compression cycle. The simplest configuration is a single compression and single expansion stage

When the temperature lift is very large, it can be more energy-efficient to perform the compression or expansion, or both, in two or more stages (multi-stage). Multi-stage systems can be configured in many different ways, and this is beyond the scope of this PAS. Consult your equipment supplier or consultant for site-specific advice on multi-stage units

**Space heating**

Heating rooms for human occupancy

**Subcritical heat pump**

A conventional heat-pump cycle where the refrigerant is operated below its critical point at all points in the compression cycle

Do not confuse a subcritical heat pump with a transcritical heat pump

#### **Temperature increase**

The increase in heat-sink temperature due to heat transferred by the heat pump. For example, if a heat pump draws heat from a heat source (such as, ambient air) at 20°C and rejects it to heat water from 50°C to 85°C, the temperature increase is 35°C

Do not confuse temperature increase with temperature lift

#### **Temperature lift**

The difference between the heat-sink temperature and the heat-source temperature

Temperature lifts can be defined for the system (for example, the temperature difference between the space or water being heated and the ambient air). They can also be defined for the HTHP (for example, the temperature difference between refrigerant condensing and evaporating). For example, if a heat pump draws heat from a heat source (such as, ambient air) at 20°C and rejects it to heat water from 50°C to 85°C, the temperature lift defined for the system is 65°C

Do not confuse temperature lift with temperature increase

#### **Thermal stratification**

When the liquid used for thermal storage has different temperatures that do not mix. Liquid density changes with temperature. Normally, higher temperature liquid rises to the top of the tank and lower temperature liquid sinks to the bottom. Stratification can be stable if, for example, hot water enters and leaves the top of the tank, and cold water enters and leaves the bottom of the tank, and flow distributors are used to prevent mixing. Such a system, if configured correctly, can increase the connected heat pump's operating efficiency and help ensure it delivers a consistently high temperature to the application

#### **Transcritical heat pump**

A heat-pump cycle where the high-pressure part of the system is operated above the refrigerant's critical point. When refrigerant is above its critical point it cannot condense. Instead, it cools as a supercritical fluid, so the 'condenser' is referred to instead as a 'gas cooler'. As the refrigerant will be a supercritical fluid on the high-pressure side of the system, the heat pump – especially the gas cooler – shall be appropriately designed

A transcritical system allows the heat pump to generate a higher temperature with its refrigerant than a subcritical (conventional) system could with the same refrigerant

### **1.4 Abbreviations**

The following abbreviations are used in this PAS:

<b>AHU</b>	Air-handling unit
<b>BLDC</b>	Brushless direct-current motor
<b>BMS</b>	Building management system
<b>CFC</b>	Chlorofluorocarbon
<b>CO<sub>2</sub>eq</b>	Carbon dioxide equivalent
<b>COP</b>	Coefficient of performance

<b>dba</b>	A-weighted decibels (measurement of sound loudness weighted to mimic the perception of the human ear)
<b>EC</b>	Electronically commutated motor
<b>EXV</b>	Electronic expansion valve
<b>GHG</b>	Greenhouse gas
<b>GWP</b>	Global warming potential
<b>HC</b>	Hydrocarbon
<b>HCFC</b>	Hydrochlorofluorocarbon
<b>HCFO</b>	Hydrochlorofluoroolefin
<b>HFC</b>	Hydrofluorocarbon
<b>HFO</b>	Hydrofluoroolefin
<b>HPWH</b>	Heat-pump water heater
<b>HTHP</b>	High-temperature heat pump
<b>HVAC</b>	Heating, ventilation, and air conditioning
<b>LAN</b>	Local area network
<b>MEPS</b>	Minimum Energy Performance Standards
<b>MVR</b>	Mechanical vapour recompression
<b>NOx</b>	Nitrogen oxide
<b>ODP</b>	Ozone depletion potential
<b>PAS</b>	Publicly available specification
<b>P<sub>c</sub></b>	Critical pressure
<b>PCB</b>	Printed circuit board
<b>PFAS</b>	Poly- or per-fluorinated alkyl substances
<b>PLC</b>	Programmable logic controller
<b>SCOP</b>	Seasonal coefficient of performance
<b>SEER</b>	Seasonal energy-efficiency ratio
<b>SG</b>	Safety group
<b>SOx</b>	Sulphur oxide
<b>T<sub>BP</sub></b>	Boiling point at standard atmospheric pressure
<b>T<sub>c</sub></b>	Critical temperature

<b>TXV</b>	Thermostatic expansion valve
<b>VPN</b>	Virtual private network
<b>VSD</b>	Variable-speed drive

## 1.5 Notation

This PAS uses the following notation:

$COP_{\text{Carnot}}$	Carnot coefficient of performance
$EF_{\text{electricity}}$	Emission factor for electricity (kg CO <sub>2eq</sub> kWh <sup>-1</sup> , or equivalents)
$EF_{\text{heating fuel}}$	Emission factor for heating fuel (for comparison; kg CO <sub>2eq</sub> kWh <sup>-1</sup> , or equivalents)
$P$	Electrical power consumption of the heat pump (kW)
$Q_{\text{cooling}}$	Amount of cooling provided by the heat pump (kW)
$Q_{\text{heating}}$	Amount of heating provided by the heat pump (kW)
$\bar{T}_{\text{sink}}$	Log mean temperature of the heat sink (°C)
$\bar{T}_{\text{source}}$	Log mean temperature of the heat source (°C)
$\eta_{\text{Carnot}}$	Thermodynamic efficiency of the heat pump relative to the Carnot cycle




## 2 Introduction to heat pumps

### 2.1 What a high-temperature heat pump is

A high-temperature heat pump (HTHP) is a device that absorbs heat energy from a heat source at a low temperature, and transfers or 'rejects', the heat energy to a heat sink at a high temperature. (In this PAS, 'high temperature' means a heat sink between 50°C and 160°C.) This has the effect of providing heat at the heat sink. Another energy source (usually electrical energy) is required to operate the heat pump.

An HTHP can be very energy-efficient, because it transfers more energy from the heat source to the heat sink (this means the amount of heating it does) than the electrical energy needed to operate it. Typically, it is also more energy-efficient to use an HTHP than an appliance that directly uses electrical energy for resistance heating (such as, a conventional electric hot-water tank). The general flow of energy is illustrated in Figure 1 below.

In a typical application, the heat source is ambient air and the heat sink is hot water. Industrial applications commonly use process low-grade waste heat as their heat source. As low-grade waste heat usually has a higher temperature than ambient air, it allows an HTHP to achieve higher temperatures with greater efficiency than air-source systems can typically attain.

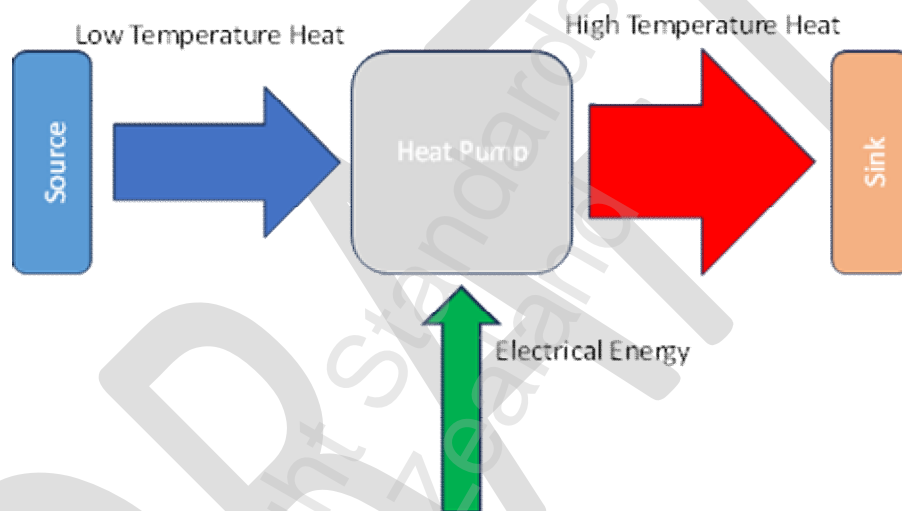

**Figure 1 – Energy flows in an HTHP**

There are several methods to implement a HTHP. This PAS considers the most common, best-developed, and generally most efficient method, which is the mechanical vapour-compression cycle (refer to Figure 2). In this type of HTHP, heat is absorbed from the heat source by evaporating a refrigerant at a low pressure and transferring heat to the heat sink by condensing, or cooling, the refrigerant at a high temperature. Most of the additional energy for operating the HTHP is used to compress the refrigerant, but also to operate fans, pumps, and controls.

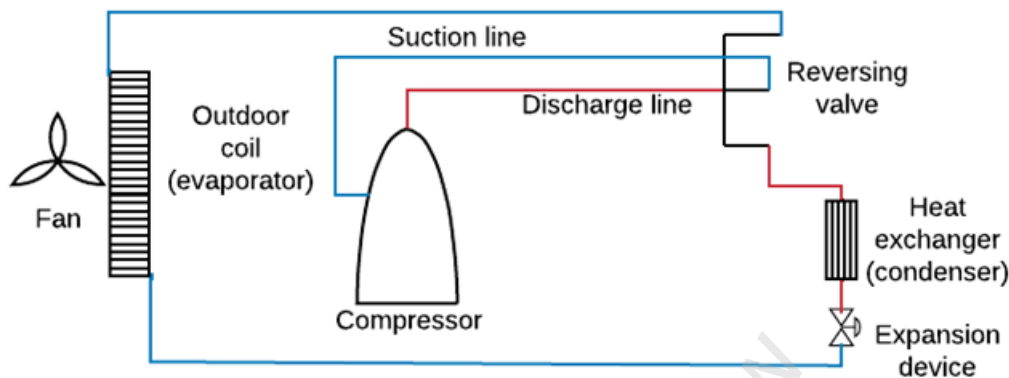


Figure 2 – Schematic diagram showing typical components in a single-stage HTHP

## 2.2 Reasons to consider a high-temperature heat pump

Under the Climate Change Response (Zero Carbon) Amendment Act 2019, the New Zealand Government has set a target to achieve net zero carbon emissions by 2050. The Government has also indicated it will align with the global pledge, agreed at the 2023 United Nations Climate Change Summit, to double energy-efficiency and treble renewable energy. Reducing the use of fossil fuels across New Zealand is an obvious step towards these targets.

Fossil fuels continue to be used in many heating applications in hospitals, prisons, and industry. As New Zealand's electrical energy supply has a high renewable component, HTHPs have excellent potential to replace coal, and other fossil fuels, for heating, which can cost-effectively mitigate the impact of heating fuel use on climate carbon.

In domestic applications, HTHPs can be a cost-effective and sustainable method of providing hot water, by replacing gas burners and direct electrical heating.

## 2.3 Advantages of high-temperature heat pumps

There are several general advantages of using HTHP technology:

- HTHP technology is **electrically powered**, so it results in lower carbon emissions than heating systems that use fossil fuels. This is especially true in New Zealand, as the electrical grid is dominated by renewable sources and connections to the grid are widely available and reliable;
- HTHP technology is **energy-efficient**, as HTHPs typically transfer more heat energy than they consume in electrical energy. They are typically more efficient, and have lower operating costs than other heating options;
- HTHPs have **lower maintenance costs** than equivalent fossil-fuel and combustion-based heating systems;
- HTHPs can efficiently meet a **variable heating demand**, by integrating them with sophisticated control systems;
- HTHPs have a **small physical and environmental footprint**, so they do not normally need a separate resource consent. They do not require fuel to be stored on site; they do not produce flue gases (such as,  $\text{SO}_x$  or  $\text{NO}_x$ ), ash, or other pollutants; and they are relatively quiet;
- In sophisticated installations, HTHPs can be used to **recover and upgrade waste heat** and **provide cooling capacity** as well as heat; and
- HTHPs are **viable for a wide range of capacities** and can be selected to suit the specific application. It is possible to install multiple small HTHPs, each close to an application, which may reduce the need for vast hot-water reticulation systems, and enable them to be gradually deployed across a site, as a retrofit or as demand grows.

Some application-specific advantages of HTHP are discussed in other sections of this PAS.

## 2.4 Limitations of high-temperature heat pumps

HTHP technology has several limitations:

- HTHPs are usually **more expensive to purchase** than other heating systems. Therefore, it is critical that they have a relatively high coefficient of performance (COP) to ensure that running costs

are significantly lower than other heating options. Potential purchasers should assess the purchase price, installation costs, and running costs to understand the lifetime cost of an HTHP;

- (b) HTHPs that use ambient heat sources have **less capacity and are less efficient as the ambient temperature reduces, or when the heating demand increases**. HTHPs typically require a defrosting cycle below about 7°C, due to frosting (ice forming) on the air-source heat-exchanger. A well-designed air-source HTHP will have an effective defrost cycle. Other technologies (such as, vapour injection) can enhance the performance of systems (particularly non-stratified or closed-loop systems) at low ambient temperatures. Apply caution with HTHPs that are designed to operate without a defrost cycle, if operating the HTHP at an ambient temperature below 5°C. In these conditions, use a resistance heater to maintain heating service;
- (c) HTHPs can be **grossly oversized and expensive** because they are often designed for the worst-case winter morning. This means they may operate part-loaded and less efficiently for most of the year. Initial costs can be greatly reduced by mitigating underperformance during extreme weather conditions, by having resistive heating or thermal tank storage. Alternatively, newer inverter-based systems can be designed to operate at an elevated capacity to meet peak demand for short periods at reduced efficiency, while offering enhanced efficiency when they operate in part-load conditions for the rest of the time. Systems with advanced controls, which are designed to operate across a wide flow rate and capacity range, can operate very efficiently in part-load conditions;
- (d) Large commercial or industrial HTHPs will **demand significant electricity**, which may require upgrading electrical supply lines within the site and in the distribution network that supplies the site from the national grid. The costs of electrical upgrades can be significant, especially for industrial sites, and shall be included in the feasibility analysis. Sites are advised to engage early with the retailer, electricity network company, and, where relevant, Transpower, to understand any upgrade requirements and their impact, so they can review the pros and cons of accommodating a large HTHP; and
- (e) HTHPs use refrigerants to convey heat around the system. **Refrigerants have various risks** associated with them, such as toxicity, flammability, and high GWP. When HTHPs are being installed, operated, maintained, and disposed of, it may be necessary to use appropriate technical and management controls, to reduce refrigerant leakage and mitigate the risks of leaks that do occur.

## 2.5 Core technologies used in heat pumps

### 2.5.1 Capacity and speed control

The compressors used in HTHPs are fixed speed or variable speed. The type of compressor used determines how the HTHP's effective heat output is controlled:

Fixed-speed compressors are widely used in HTHPs as a single compressor circuit. When the heat-pump output exceeds the heating demand, the system can be cycled on and off. Connecting to a storage tank reduces the cycling frequency. When there is a need for a heat pump with a variable output, multiple fixed-speed compressors can be used as part of the same circuit, or via individual circuits.

Some fixed-speed compressor-based systems control capacity by allowing refrigerant to bypass either within the compression chamber, or between the discharge and suction ports (for example, slide valves are a bypass technology for screw compressors). Refrigerant bypass decreases the efficiency of a heat-pump system.

A compressor's output can also be controlled by varying the compressor speed. Typically, this is achieved by using a variable-speed drive, to reduce the compressor speed, or a brushless direct-current (BLDC) compressor motor and inverter drive (this is referred to as an inverter compressor system). An inverter drive can allow the compressor to rotate at high speeds, which increases compressor output. It can also reduce compressor speed, which makes the system more efficient under part-load conditions.

### 2.5.2 Compressor type

Compressors used in HTHPs can also be classified by how they compress the refrigerant. Five types of compressors are commonly used:

- (a) **Rotary compressors** are often used in HTHPs with lower capacity. Rotary compressors contain a large cylinder with a smaller vane that rotates eccentrically within a casing;
- (b) **Scroll compressors** are widely used in HTHPs with medium capacity. Scroll compressors contain two interleaving scroll plates (these resemble spirals); one is stationary and the other orbits eccentrically. The capacity can be controlled by changing the speed of the scroll plates, or allowing more bypass to occur. Compliant scroll compressors can allow small amounts of liquid to pass

through the compressor without damaging the compression head, which makes the compressor more durable;

- (c) **Reciprocating compressors** resemble a piston within a cylinder. Multiple compressors can be connected to a common drive shaft. The HTHP's output can be varied by changing the speed of the drive shaft. Reciprocating compressors are particularly susceptible to damage from liquid entering the compression chamber;
- (d) **Screw compressors** are often used in HTHPs with higher capacity that use lower pressure refrigerants. Their capacity can be controlled by changing the rotating speed of the screws, which allows more bypass to occur, or via a slide valve, or both; and
- (e) **Centrifugal compressors** are used in HTHPs with high capacity that use lower pressure refrigerants. Their capacity is controlled by the compressor's rotating speed. Centrifugal compressors with magnetic bearings do not need oil as a lubricant in the system.


#### 2.5.3 Liquid-injection cycle

A liquid-injection cycle is used to control the temperature of gas discharged from the compressor when it would otherwise be too high. A small amount of liquid refrigerant is injected into a second inlet port on the compressor.

#### 2.5.4 Vapour-injection (economised) cycle

A vapour-injection or 'economised' cycle also uses the compressor's second inlet port. In industrial-scale screw compressors, this port is often called an 'economiser' port. In a vapour-injection cycle, liquid refrigerant is sub-cooled after the condenser, using another heat-exchanger or flash vessel. Some of the refrigerant boils or 'flashes' to sub-cool the rest of the refrigerant at an intermediate pressure (this is known as 'two-stage expansion'). The flash vapour is compressed via the compressor's vapour-injection port. This is called enhanced vapour injection (EVI).

The vapour-injection cycle increases the heat pump's capacity and energy-efficiency, because the sub-cooled refrigerant means a lower refrigerant flowrate can deliver the same amount of heating, and the sub-cooling flash vapour is compressed only from intermediate pressure to discharge pressure (rather than from the lower suction pressure to the discharge pressure).

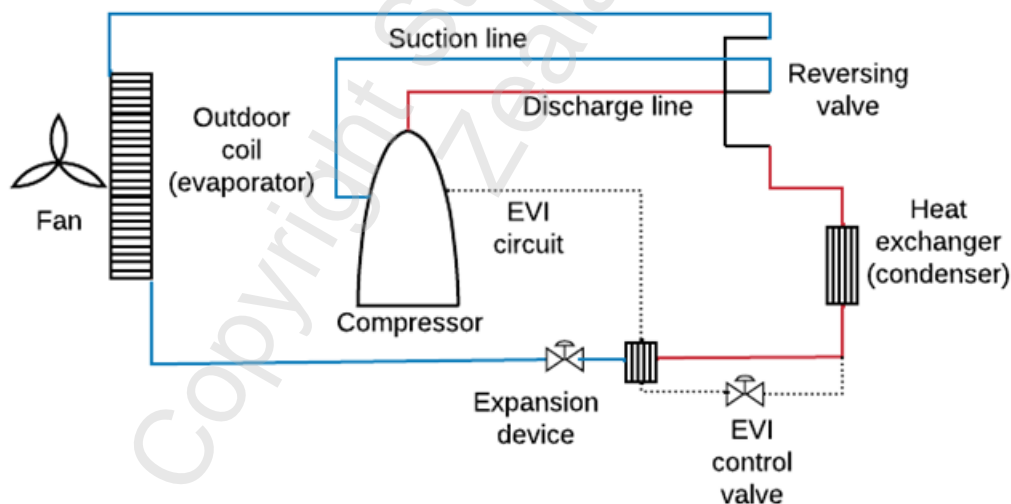

**Figure 3 – Schematic illustrating the addition of EVI to a single-stage HTHP**

R744 (carbon dioxide) systems commonly use a small separate compressor to compress the flash gas from the sub-cooler, instead of a vapour-injection port. This configuration is often referred to as 'parallel compression'. It has the same benefits as vapour injection.

#### 2.5.5 Metering or throttling devices

The flow of refrigerant through the cycle is controlled by a metering or throttling device. This device creates a pressure drop, which causes the fluid to expand before it enters the evaporator. There are four main types of metering devices:

- (a) **Electronic expansion valves (EXV)** are more expensive than thermostatic expansion valves, but they allow more precise metering of refrigerant flow through a heat-pump system. An EXV can keep the refrigerant superheat at the evaporator exit stable at lower superheat values, which provides efficiency benefits;
- (b) **Thermostatic expansion valves (TXV)** have a small opening that is opened or closed by a diaphragm. This diaphragm is controlled by fluid that expands or contracts, based on its temperature. TXV are a cost-effective way of controlling the flow of refrigerant. They perform reasonably well, but have a limited operating range and often require manual adjustment. To achieve stable operation, the superheat value is often higher than EXV, which can be less efficient;
- (c) **Capillary tubes** are the most basic way to control the flow of refrigerant. They consist of a fixed length of tube with a very small diameter, which creates a fixed-pressure drop. Capillary tubes are inexpensive, but they have a very small operating range and provide limited stability of superheat. This compromises their performance and efficiency, so they should not be used; and
- (d) **An on/off or modulating valve** that controls the refrigerant-liquid level in a downstream, low-pressure vessel. This type of valve is used in large systems that are not configured as direct expansion.

#### 2.5.6 Motor types

Electronically commutated (EC) motors, BLDC motors, or permanent magnet motors are supplied with DC electricity and have an artificially rotating field around them. This technology gives the motor a larger speed range than is normally possible with an AC motor. Small- and medium-scale heat pumps that use an inverter compressor, and variable-speed fans and pumps, are commonly based on this technology. These motors are usually much more efficient than small-scale, shaded pole motors, which are found in evaporator fans and pumps associated with HTHPs.

#### 2.5.7 Defrost methods

Heat pumps need water heaters to defrost the evaporator coils, when they operate in ambient temperatures below approximately 7°C, as ice accumulates. There are two main methods to defrost coils:

- (a) **Reverse-cycle operation** allows the unit to operate temporarily in cooling mode, and uses the heat generated to de-ice the coil; and
- (b) **Hot-gas bypass systems** essentially short-circuit the compressor discharge through the evaporator coil, which allows the heat of the compressor motor to defrost the coil.

Reverse-cycle operation is generally more efficient than hot-gas bypass systems, but it requires the refrigerant volume in the evaporator and condenser to be approximately the same.



### 3 Domestic Heat-pump Water Heaters

#### 3.1 General

Domestic heat-pump water heaters (HPWH) tend to be smaller capacity (3 to 5 kW) air-source units. In general, they can replace a household's existing hot-water heater, but, in some cases, they can supplement an existing hot-water system.

They are designed for light-to-medium duty and should have a design life of well over 10 years. These units are not generally covered by a service contract, so significant faults are likely to result in replacing a unit rather than repairing it.

The air-source for the evaporator can be outside air or, in some instances, air ducted from within the building envelope.

Some models may also be used to provide space heating or cooling, although these models typically have higher upfront costs than dedicated HPWH.

#### 3.2 Technologies available

##### 3.2.1 Integrated 'all in one' units

These units consist of a tank, with a small refrigeration system mounted at the top or base. These units can source air from the immediate surroundings or have it ducted to and/or from the unit. The condensers can be wrapped around the outside of the tank, located within the tank, or located within the housing of the unit. Units with a wrap-around condenser generally need a larger tank (more than 270 L) to allow sufficient refrigerant sub-cooling while delivering an acceptable quantity of hot water.

##### 3.2.2 Split units


Typically, split units offer greater heating capacity than integrated units, as they separate the refrigeration system from the storage tank. Split units can heat the water outside of the tank and pipe it to the tank, or they can pipe refrigerant to a heat-exchanger within the tank. In units with an external heat-exchanger, the heated water can be delivered to the top of tank at the required temperature and thermally layered from the top of the tank down (a single-pass unit). Alternatively, the heated water can be supplied near the bottom of the tank, which heats the water in the tank from the bottom up (a multi-pass unit).

##### 3.2.2.1 Single-pass units

Single-pass units can be used to produce domestic hot water, particularly when the demand exceeds the capabilities of integrated units. Single-pass units have these main advantages:

- (a) They rapidly recover hot water once the tank is depleted;
- (b) They take advantage of the natural thermal stratification that occurs in 'push-through' heated-water storage tanks. This increases the sub-cooling and, therefore, the efficiency of the heat-pump system;
- (c) They significantly reduce the peak refrigerant pressure for a given target water temperature, which increases the efficiency and durability of the compressor; and
- (d) They integrate more effectively into systems that demand flexibility.


When single-pass units are applied to reticulated-return, or 'ring-main', systems, care is required to maintain the thermal stratification within the storage tank.

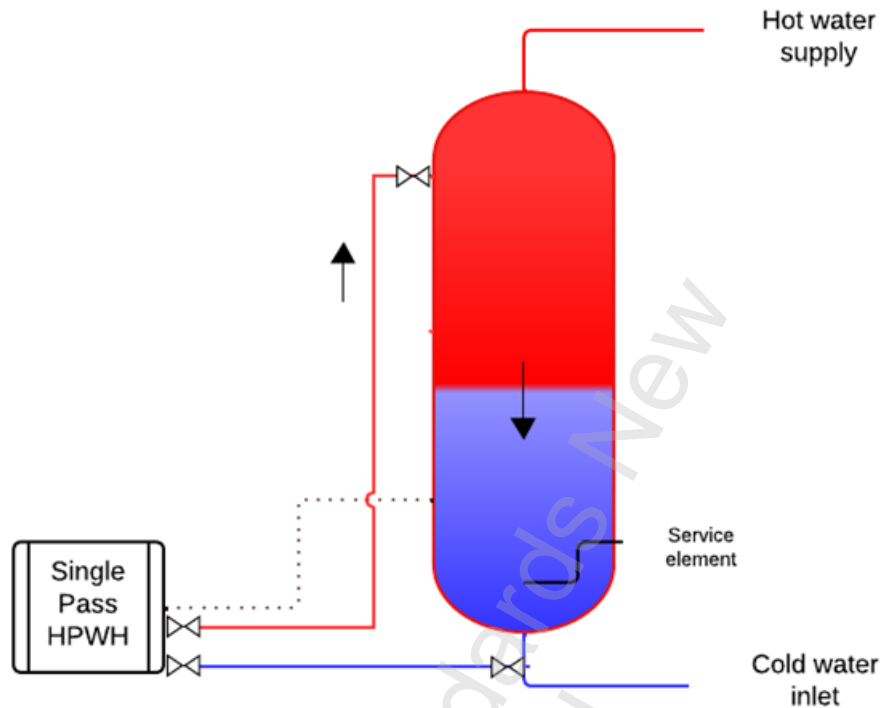

**Figure 4 – Schematic showing the integration of a single-pass HPWH with a domestic hot water system**

### 3.2.2.2 Multi-pass units

Multi-pass units need to be carefully designed and applied, to be effective domestic HPWH. This is primarily because a high flowrate is required between the heat pump and the storage tank, which generally results in the tank becoming 'mixed'. 'Mixing' the storage tank means that, for a large proportion of the time, the heat pump operates with a high inlet water temperature (top-up heating after relatively small hot-water draws). Heat pumps operate less efficiently with high-temperature inlet water than with low-temperature inlet water.

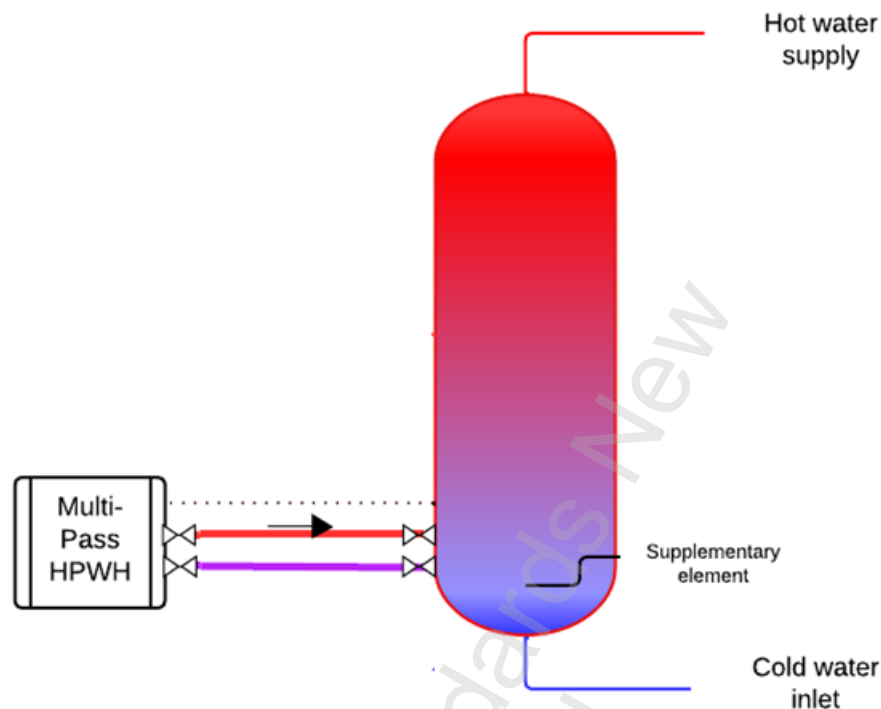

**Figure 5 – Schematic illustrating integration of a multi-pass HPWH with a domestic hot water system**

### 3.2.2.3 Combined space-and-water-heating heat pumps

Although these units are available, they should be carefully considered and applied, because they have some disadvantages:

- (a) In general, space heating needs more capacity than hot-water heating, which leads to a mismatch outside the winter space-heating season;
- (b) In general, the temperatures required for water heating are higher than for space heating. Systems that store water at the temperature required for hot water, but which use it for space heating, are inefficient for two reasons:
  - (i) the heat for space heating is generated at the same high temperature lift required for the hot water, while a separate system could generate it more efficiently with a lower temperature lift
  - (ii) the thermal-storage system leads to larger heat losses; and
- (c) Inverter units with separate refrigerant-to-water heat-exchangers for the space and water heating applications are more efficient, because the target water temperature can be adjusted. However, their water heating is less efficient than an integrated or single-pass HPWH.

## 3.3 Heat-exchangers for potable-water systems

For domestic HPWH, the choice of heat-exchanger between the refrigerant system and potable water is an important consideration. This is especially true in regions that have higher levels of dissolved minerals in the water. In general, plate heat-exchangers, or other compact types with small flow channels, initially offer good heat-transfer features. However, their performance is prone to deteriorate due to fouling – when the passages between the plates become blocked. These blockages reduce the performance of the heat-exchanger performance. In addition, the refrigerant pressure and discharge temperatures of the refrigeration system increase, which can reduce the compressor's service life.

In this respect, HPWH with 'wrap-around', 'co-axial', and 'tube-in-shell' condensers, which are less prone to fouling, are likely to provide a longer service life.



## 4 Refrigerants for domestic applications

### 4.1 General

Refrigerant is a critical element of a domestic heat pump. A refrigerant is referred to by an alphanumeric code (for example, R32), which indicates its chemical composition. Appendix 1 contains a list of some potential refrigerants, but this is not an exhaustive list. Talk to your supplier about which refrigerant is appropriate for your specific requirements.

Domestic HPWHs use a range of refrigerants. Older systems often contain refrigerants with high GWP, such as R134a, R407c, and R410a. More recent products often contain refrigerants with much lower GWP, such as R32, R290 (propane), R600a (iso-butane), and R744 (CO<sub>2</sub>).

Single-pass units are available as R32 or CO<sub>2</sub>. R32 products are more cost-effective than CO<sub>2</sub> products, but CO<sub>2</sub> products allow higher water temperatures to be achieved. The range of propane and iso-butane options is expected to increase.

### 4.2 Environmental and safety issues

Many current refrigerants are hydrofluorocarbons (HFCs). HFCs are potent greenhouse gases (GHGs) that, if released to the atmosphere, contribute to climate change. These refrigerants are anticipated to become less readily available, due to international efforts to reduce their impact on the climate.

Some refrigerants are also hazardous due to their toxicity or flammability. The refrigerant installed in a heat pump shall be appropriately labelled and correct safety measures applied for its specific hazard level. See AS/NZS ISO 817:2016 for definitions of safety levels.

It is generally not advised to charge an HTHP with a different refrigerant to the one it was designed to use. Refrigerants of different safety classifications require different engineering controls, so charging an HTHP with a refrigerant that has a different safety class could be hazardous to people or property. Consult an appropriately qualified technician before doing this.

'Charge minimisation' means designing a heat-pump system to use as little refrigerant as possible. This practice can be cost-efficient and can mitigate some of the risks associated with using hazardous refrigerants.

When consumers select a refrigerant for their application, they are recommended to select the refrigerant with the lowest GWP practicable (at least GWP < 750), given cost and efficiencies. If they use a refrigerant with hazardous qualities, they shall implement all the appropriate safety measures.

### 4.3 Refrigerant leaks

In a sealed HTHP unit, the refrigerant is designed to remain within the system. However, refrigerant leaks will occur if pipes or other components fracture, due to corrosion or metal fatigue from vibration.

Consumers should ensure they service their HTHP unit as specified by the manufacturer. They should also carefully observe any change in the home's water temperature, or increased power consumption by the HTHP, as these may indicate a refrigerant leak.

### 4.4 Temperature constraints

To achieve high energy-efficiency, most HTHPs operate with the refrigerant condensing temperature well below the refrigerant's critical temperature. The critical temperature (see Table 1) is the upper temperature limit that most systems can provide at the heat sink.

## 5 Operational considerations for domestic heat pumps

### 5.1 General

The temperature of some heat sources, such as ambient air, vary according to the time of day and season. The COP of an installed HTHP will, therefore, vary according to these conditions. However, a properly specified and configured HTHP should deliver the desired temperature despite changes in the heat source.

Integration of the heat pump with the hot-water system is an important consideration for HPWH. A residential HPWH has the potential to be more efficient when the water-inlet temperature is colder. This is especially the case with CO<sub>2</sub> heat pumps, which require a relatively cool water-inlet temperature to be efficient and maintain heating capacity.

### 5.2 Thermal stratification

In domestic applications, HTHPs are most often used for water heating. Therefore, they frequently incorporate some form of thermal storage (typically an insulated water tank). If the thermal storage is sufficiently large, it may allow the HTHP operation to be reduced or shut off at times when there is a high demand on the electricity network. Depending on consumers' electricity tariffs, this may mean they avoid significant demand charges for electricity and allow them to use cheaper, off-peak electricity.

The design and implementation of thermal-storage-and-distribution systems should be carefully considered, as they can affect the temperature supplied to, and by, the HTHP. Heat pumps can perform less well, and be less efficient and durable, if they are operated with a much lower temperature lift across the heat-pump condenser than they are designed for. This should be considered in the design of any thermal storage system.

To maximise the performance of an HTHP, it is good practice to maintain the thermal storage as a stratified tank. In a stratified tank, higher temperature (lower density) water will be at the top of the tank, while lower temperature (higher density) water will be in the lower portion. This results in water of different temperatures forming natural layers in an unmixed vessel. Figure 4 illustrates a stratified tank.

Maintaining 'stratification' allows the heat pump to draw water from the coldest area of the tank (that is, the bottom) to cool the condenser and sub-cool the refrigerant. The heated water is then returned to the hottest area of the tank (that is, the top). The heat-distribution network would draw from the hottest part of the tank to satisfy the heating load, while adding make-up water to the coldest part of the tank. This allows the heat pump to supply the hottest possible temperature to the application. It is important that the water in the storage tank is not allowed to mix to maintain the stratification effect, so the tank inflow and outflow shall be set up with this in mind (for example, a distribution plate is often included in the storage tank).

In most cases, domestic HTHP potable-water heaters need a storage tank. In most installations the hot-water outlets are directly supplied from the storage tank, without a reticulated pumped circuit. The water heater should be designed to maintain natural thermal stratification in the tank by applying these approaches:

- (a) Avoid using electric elements in the base of the tank. If the water heater requires an electric element, ensure it is positioned above the tank's temperature sensor;
- (b) Control the flow rate from the HTHP into the tank, based on the manufacturer's specifications. Single-pass units have an inherently controlled flow;
- (c) Ensure that the size of the port that connects heated water from the heat pump to the tank is sufficient for the design velocity into the tank to be no greater than 0.5 m/s, unless there are internal baffles in the tank;
- (d) Ensure that the hot-water return from the heat pump is to the top of the tank (single-pass system) or to the bottom of the tank below the thermostat (multi-pass system); and
- (e) Avoid connecting reticulated-return connections to the main storage tank, unless the system is specifically designed for this.

Thermal conduction down the walls of a tank is a key factor in heat-energy transfer between stratified layers. Tanks made from lower thermal conductivity materials (such as, stainless steel) are generally preferred for thermally stratified systems, but should still be insulated.

### 5.3 Legionella control

*Legionella pneumophila* cause Legionnaires' disease, which is a severe form of pneumonia. Heated-water systems can support the bacteria *legionella pneumophila* to grow. Installations that supply

reticulated hot water that is tempered to 45°C at the tank are particularly vulnerable to *legionella pneumophila*.

The design of any thermal-storage system should consider this risk and take appropriate measures to prevent it. For example, regularly heating the tank to at least 60°C and using ultraviolet (UV) sterilisers are common ways to prevent *legionella pneumophila* growing. The NZBC G12 contains a range of other options for controlling the growth.

When installing heated-water systems at places that serve people with compromised immune systems, such as hospitals and care facilities, particular care is needed.

#### 5.4 Controls

In a residential situation, an HTHP should be automatically controlled, with minimal input from the user.

The tank sensor shall be raised sufficiently from the base of the tank, so the HTHP operates for at least 20 minutes without hot-water draw-off when activated. The thermostat deadband shall be at least 10 K for a multi-pass or integrated unit, or at least 25 K for a single-pass unit.

An HTHP shall be sized and configured to meet the premises' hot-water demand without needing a supplementary heater. Products shall also have an active defrost method. If the lower region of the tank has a backup element, this shall be activated only if a fault occurs with the HTHP. Some units incorporate the installed element as a supplementary heater for higher heating capacity, or have a higher temperature setpoint. However, this feature significantly reduces the water heater's energy-efficiency, and should be avoided.

A few products are designed to be integrated with a reticulated, or 'ring-main' hot-water system. Unless the manufacturer specifically supports this function, using a heat pump for a ring-main system is not recommended.

Typically, residential HTHPs are not connected to load-management-control tariffs. In future, heat pumps with external connectivity (such as, Wi-Fi) will be more common and may allow owners or demand-flexibility aggregators to manage the load.

Some units have a timer function. This allows them to operate more efficiently, when they are set to operate during the warmer periods of the day.

Ducted units produce significant quantities of cold, dry air, which can help to cool and dehumidify the building envelope when configured. In parts of New Zealand, this is a useful feature during the warmer seasons. However, caution is needed to ensure that ducting and dampers do not exceed the minimum airflow requirements provided by the manufacturer.

#### 5.5 Factors that affect performance and durability

For water heating, HTHPs are most effective when they can operate continuously for sustained periods when heating is required. If the heating capacity is 'oversized', relative to the thermal load or demand for hot water, the HTHP will 'short cycle' or repeatedly turn on and off. Short-cycling can accelerate the degradation of the system's components and reduce its performance.

To prevent short-cycling, a hot-water storage tank is recommended. The storage tank and controls should be configured so that the HTHP turns on once the hot water in the tank is significantly depleted, and turns off when the tank is fully recharged with hot water (see 5.4).

If the heating capacity is 'undersized', the HTHP may fail to meet the required heating demand and need 'boosting' (this often involves an electrical heating element), which may reduce the system's annual energy savings.

A well-designed HTHP will not need an electric resistance heater to meet the required water temperature, unless the environmental conditions are extreme. Routinely using resistance heaters in the tank will significantly reduce the HTHP's efficiency.

Using resistance heaters to maintain reticulation losses in a thermally isolated zone, as part of a thermally stratified system, can be an appropriate solution for commercial systems.

#### 5.6 Compliance and standards

Air-source HTHPs for domestic water-heating systems shall be tested to AS/NZS 5125. AS/NZS 5125 involves measuring the power input, and the thermal energy a unit produces when it is coupled to a storage tank under a range of standardised test conditions.

AS/NZS 4234 shall be used to estimate the annual energy consumption and seasonal coefficient of performance (SCOP). The performance coefficients, determined by analysing the test results from AS/NZS 5125 or an equivalent test methodology, can be entered into a thermal-simulation software package using AS/NZS 4234. The energy use can be compared with a reference heating system, such as a boiler. By applying the carbon-emission factor for the energy consumed by the system, the difference in GHG emissions between two or more systems can be calculated.

Variable-speed HTHPs shall be tested in accordance with AS/NZS 5125, or an equivalent methodology for non-air-source systems.

The Tapping Load test, described in Appendix G of AS/NZS 5125, provides an alternative approach to assess the performance of an HTHP used for heating water in a domestic context. The main advantage of the Tapping Load test is that it tests the water heater on the basis of its energy content versus the electrical energy required to produce it, and does not consider the technology involved. ISO 21978:2021 and EN 14511-1:2018 describe similar test methods.

## **5.7 Performance verification**

The approximate in-situ performance of a domestic HPWH is best determined by measuring the volume of hot water delivered from a tempering valve installed on the outlet of the water heater, the electricity used, and the location's monthly cold-water temperature. The set temperature of the tempering valve shall be at least 5°C lower than the HPWH setpoint.

More precise analysis of energy performance requires measuring, in-situ, the temperature at the storage tank's hot-water outlet and cold-water inlet, the flow rate, and electricity usage, at least every five seconds.

Determining in-situ energy performance for a multi-pass HTHP, by measuring the flow rate and temperatures, results in excessive errors. This is because these units have a high flow rate and low temperature differential. This approach is more suitable for single-pass units, although the energy used for defrost needs to be accounted for. It is preferable to measure performance based on the total hot water delivered from the tank to the household and total energy use.

## **5.8 Replacement of an instantaneous gas hot-water heater**

Instantaneous gas hot-water heaters (sometimes known as on-demand hot-water heaters, gas califonts, or instant hot-water heaters) heat hot water as the water is needed, without using a hot-water tank for thermal storage. The power supply has sufficient capacity for a HPWH. In many instances, these systems are mounted on the external wall of a house. The most appropriate options for external installation are integrated HPWHs or single-pass split units. In most cases these installations do not require a building consent.

## **5.9 Replacement of an internal electric water heater**

In many cases, there is not enough space where an existing tank is located to fit an integrated HPWH. When an existing tank is suitable and in good condition, a split single-pass HPWH can be fitted to the existing tank, provided that the pipe lengths do not exceed the manufacturer's recommendation. Generally, this does not require a building consent.

When a tank cannot be reused, and needs to be repositioned, specialist advice and a building consent may be required. Consult Schedule 1 of the NZBC to determine whether a building consent is required to replace a water heater.

## 6 Specification for domestic heat-pump water heaters

Domestic HPWHs are recommended to follow these requirements:

- (a) The HPWH should typically provide the hot-water storage specified in Table 1 for the number of occupants in the household;
- (b) To maintain stratification, at least one tank volume should be drawn through the tank each day;
- (c) Integral condenser units should have the condenser concentrated towards the lower section of the storage vessel, for best thermal performance;
- (d) The HPWH should deliver a water temperature of at least 60°C without needing a booster element;
- (e) Integrated units should have external installation to maintain a noise level below 60 dBA;
- (f) Units installed within the building envelope should have ducting for the inlet and exhaust air, and the manufacturer's limits on duct length should be observed;
- (g) The HPWH should have a SCOP greater than 3.0, as determined by AS/NZS 4234 modelling; and
- (h) The sound-pressure level of units designed to be installed outside should be less than 55 dbA at 3 m from the unit.

**Table 1 – Determining the demand for a domestic water heater**

<b>Number of occupants</b>	<b>1–3</b>	<b>4–6</b>	<b>6–10</b>
Medium / mains pressure (L)	150–180	180–300	> 300
Capacity (kW)	2	3	4



## 7 Commercial high-temperature heat pumps

### 7.1 General

Commercial HTHPs generally have greater capacity than those used for residential applications. They are produced in moderate quantities to a fully engineered design. They are not mass-produced by semi-automated production systems.

Commercial HTHPs can be used for a wide range of applications related to commercial buildings, and to support industrial processes. It is important to select the most suitable product for the specific application. They often require professional design services to be successfully implemented.

### 7.2 Refrigerants for commercial applications

#### 7.2.1 General

Refrigerant is a critical element of a commercial heat pump. A refrigerant is referred to by an alphanumeric code (for example, R32), which indicates its chemical composition. Appendix 1 contains a list of some potential refrigerants, but this is not an exhaustive list. Talk to your supplier about which refrigerant is appropriate for your specific requirements.

#### 7.2.2 Environmental and safety issues

Many current refrigerants are HFCs. HFCs are potent GHGs that, if released to the atmosphere, contribute to climate change. These refrigerants are anticipated to become less readily available, due to international efforts to reduce their impact on the climate.

Some refrigerants are also hazardous due to their toxicity or flammability. The refrigerant installed in a heat pump shall be appropriately labelled and correct safety measures applied for its specific hazard level. See AS/NZS ISO 817:2016 for definitions of safety levels.

It is generally not advised to charge an HTHP with a different refrigerant to the one it was designed to use. Refrigerants of different safety classifications require different engineering controls, so charging an HTHP with a refrigerant that has a different safety class could be hazardous to people or property. Consult an appropriately qualified technician before doing this.

'Charge minimisation' means designing a heat-pump system to use as little refrigerant as possible. This practice can be cost-efficient and can mitigate some of the risks associated with using hazardous refrigerants.

When consumers select a refrigerant for their application, they are recommended to select the refrigerant with the lowest GWP practicable (at least GWP < 750). If they use a refrigerant with hazardous qualities, they shall implement all the appropriate safety measures.

#### 7.2.3 Refrigerant leaks

In a sealed HTHP unit, the refrigerant is designed to remain within the system. However, refrigerant leaks will occur if pipes or other components fracture, due to corrosion or metal fatigue from vibration.

Consumers should ensure they service their HTHP unit regularly, in accordance with the manufacturer's specifications. The service should include checking for potential refrigerant leaks. Consumers should also carefully observe any change in the available water temperature, any increased power consumption by the HTHP, or any unexplained, significant increase in the time it takes to recover the tank, as these may indicate a refrigerant leak. If you are able to access the unit controller data locally or remotely, check the recorded position of the electronic expansion valves. If they are regularly in the fully open position, this also indicates a refrigerant leak. If you are able to access the unit controller data locally or remotely, check the recorded position of the electronic expansion valves. If they are regularly in the fully open position, this also indicates a refrigerant leak.

### 7.3 Temperature

#### 7.3.1 Temperature of the heat source and heat sink, and the return-water temperature

HTHPs operate most efficiently when the temperature lift between the heat sink and heat source is minimised. Where possible, the system should deliver the coolest possible water temperature, while still meeting the heating requirement. For example, in a radiator system, if 60°C water satisfies the heating requirement, a heat pump that delivers 60°C water is more efficient than one that delivers 70°C water. Similarly, the system should use the heat source with the warmest possible temperature (for example, warm exhaust air from the building rather than colder ambient air).

The return-water temperature back to the heat pump is also an important design consideration for many HPWH. In general, a heat pump is more efficient when the heat-sink-temperature increase (that is, the water temperature increase across the heat-exchanger) is greater. This is especially the case for CO<sub>2</sub> heat pumps which require a relatively cool return-water temperature to maintain high heating capacity and high efficiency.

The following strategy can be used to minimise the temperature lift while also maximising the temperature increase across the heating side of the heat pump:

- (a) Determine the warmest heat source available. While this is often the ambient air, if waste heat sources are available, choose the warmest;
- (b) Investigate the heating requirement at the application, and select the coldest temperature that will meet this requirement (this is the heat sink). Together, steps (a) and (b) minimise the temperature lift; and
- (c) Configure the flow of the fluid to be heated on the HTHP's heat-sink side, so that it is heated to the required temperature – determined in step (b) – from the coldest possible starting temperature, without wasting the heat stored in reticulated systems. For reticulated hot-water systems, thermal storage with stratification achieves this. It is configured so that the coldest water in the thermal storage is sent to the heat pump, to be heated to the required temperature for the application. Step (c) maximises the temperature increase across the heat-sink side of the heat pump.

The temperature of some heat sources (such as, ambient air) varies according to the season and time of day. Therefore, the energy-efficiency of an installed HTHP may vary, according to the conditions. However, a properly specified and configured HTHP should provide heating at the desired temperature despite changes to the heat-source temperature.

HTHPs that use ambient air as the heat source for space heating will be most heavily constrained on cold days when the heating demand is also high. Overall, the system should be designed to perform in these worst-case conditions. However, rather than sizing the HTHP for these conditions, it can sometimes be more cost-effective to use a smaller HTHP with an auxiliary heating system (such as an electric resistance heater) or thermal storage (that is, a hot-water tank). This solution means using the HTHP alone on most days but supplementing it with the auxiliary heating system on extreme-temperature days. Alternatively, an inverter-based HTHP can support limited periods of higher-speed operation to meet the heating demand during extreme-temperature events.

### 7.3.2 Temperature constraints

To be energy-efficient, most HTHPs operate with the refrigerant condensing temperature well below the refrigerant critical point. In most systems, the refrigerant critical point (see Table A1) sets an upper limit for the temperature that can be provided at the heat sink. In practice, most heat pumps operate at least 10°C below the critical point.

Specially designed transcritical heat-pump systems can operate efficiently when the heat-sink temperature is at, or above, the critical point. These system configurations are common when CO<sub>2</sub> (R744) is the refrigerant, but seldom when other refrigerants are used. Transcritical systems may become more common in the future for HTHPs whose heat sinks have a very high or variable temperature.

The refrigerant boiling point at atmospheric pressure (see Table 1) constrains the temperature at the heat source, to avoid the HTHP operating in a vacuum condition at the compressor suction. The refrigerant selected should have a lower boiling point, at atmospheric pressure, than the usual heat-source temperature. In most systems, the refrigerant boiling point sets the lower temperature constraint, based on what is practical for the heat source. Refrigerants with higher boiling points (these are sometimes called 'low-pressure refrigerants') are less dense as vapour at the heat-source temperature. They will, therefore, need compressors, heat-exchangers, and piping that are physically larger than high-pressure refrigerants would need at the same temperatures. Requiring larger equipment typically increases the capital costs associated with low-pressure refrigerants.

## 7.4 Direction of technological development

There are several current trends in commercial HTHP development:

- (a) A transition towards refrigerants with low GWP, such as R32, R454b, and their equivalents. Products with GWP > 750 are not recommended, as alternatives are available;
- (b) An increase in the use of natural refrigerants, such as CO<sub>2</sub> and hydrocarbons (HC);
- (c) An increase in the adoption of inverter compressors for applications that can use the improved part-load efficiency;
- (d) The adoption of HTHPs that support variable-flow hydronic space-heating systems; and

- (e) An increase in the use of mixed-mode hydronic systems that allow simultaneous heating and cooling.

For safety and cost reasons, secondary reticulation systems are also being used more, to physically isolate the primary refrigerant circuit and have lower charge. For example, they allow hazardous refrigerants with lower GWP to be used safely. In HTHPs, the secondary reticulation fluid is often water and, in commercial applications, the secondary refrigerant circuit is often referred to as a 'hydronic loop'.

Secondary systems can be less efficient, due to the primary circuit operating at more extreme conditions and the secondary circuit needing extra pumping power. However, they have the advantage of decoupling the outdoor and indoor units, which allows the outdoor unit to be replaced without needing to simultaneously replace the indoor unit(s).

## **7.5 Electrical supply and controls**

### **7.5.1 Electrical supply**

Smaller HTHPs may be connected to an existing electrical installation relatively easily. However, the should still be investigated, to check it has sufficient capacity and capability to operate the HTHP in the proposed location.

Larger HTHPs have significant electricity demands. A proposed site may need to be extensively investigated to ensure that the following requirements can be met:

- (a) When the HTHP is running in the electrical installation in the desired location, there is sufficient capacity to start and operate it satisfactorily;
- (b) When the HTHP is used in a controlled or uncontrolled mode, it does not affect the electricity purchasing contracts for the electrical installation; and
- (c) The HTHP can provide at least one of these benefits:
  - (i) Thermal storage, which provides additional flexibility about when the HTHP operates, to minimise its connection and operating costs
  - (ii) Peak-demand or time-controlled systems that reduce electricity consumption, to minimise capacity investment or purchasing electricity at high-cost periods. 'Time-of-use' electricity pricing is becoming increasingly common in New Zealand, as 'demand-flexibility' as a service becomes available. When an HTHP is correctly sized and configured, thermal storage can ensure heat is always available, while also making use of lower electricity prices.

The site investigation should include consulting with the electricity retailer and the owner of the network about these matters:

- (a) Any potential impact the HTHP will have on the current electricity purchasing and connection contracts;
- (b) Any alternative purchasing contracts that may offer greater benefits, or incur penalties, particularly if control is enabled on the HTHP; and
- (c) Any costs associated with connecting the HTHP, within the electrical installation and the local supply network.

### **7.5.2 Controls**

A modern HTHP is controlled by a microprocessor, which is typically part of a printed circuit board (PCB). A PCB has sensor inputs to measure various parts of the refrigeration system. It can also have electromechanical outputs (such as, relays), analogue outputs (such as, 0–10 V control signal), or communication-based outputs. A PCB controls the compressor cycling or inverter speed, the fan speed, and the metering device (that is, the electronic expansion valve). A PCB can also control the operation of pumps and valves.

Some systems use a programmable logic controller (PLC) instead of a PCB. A PLC has many of the same functions as a PCB, but it can also be part of integrating the HTHP to the site's controls.

A building automation specialist may be needed to connect a commercial HTHP to a building management system (BMS), as part of integrating the HTHP to the heating system. This is an important aspect of successfully applying HTHP technology, especially in retrofit projects, that requires specialist knowledge of the application and product, particularly when the BMS system will control the HTHP.

## **7.6 Factors affecting durability and lifetime**

A HTHP system shall be designed to operate reliably and efficiently for at least 15 years in the environment where it is installed. Several factors reduce the lifetime of the system:

- (a) Condensing pressure and discharge temperature that exceed the operating envelope supplied by the compressor manufacturer;
- (b) Insufficient suction superheat, especially when combined with insufficient discharge superheat;



- (c) Corrosion of the heat pump's cabinetry and base. This can be prevented by ensuring that water can drain freely at the base of the unit, and does not pool;
- (d) Corrosion of coils, especially in marine and geothermal environments. HTHPs use aluminium fins, which need to be suitably coated to prevent corrosion. In some environments, some systems need more protection than stated by the equipment manufacturer;
- (e) Blocked water-side flow channels in the water-heating heat-exchanger, if the water quality is poor or has high levels of minerals that form scale. This can be a particular risk for heat-exchangers that have smaller flow channels (such as, compact heat-exchangers like plate heat-exchangers). Even if the flow is not completely blocked, scaling on the heat-transfer surfaces can reduce the effectiveness of heat transfer, which reduces the system's heating capacity and COP over time. It also increases the refrigerant pressure and discharge temperatures, which could reduce the service life of the compressor;
- (f) An operating system that does not comply with the manufacturer's stated operating limits. Consumers should pay attention to the manufacturer's test conditions when they select a unit. They should ensure the application's design condition is within the manufacturer's operating envelope for the compressor;
- (g) An HTHP system that is sized to meet an extreme design condition but usually operates at part-load conditions. Sizing and controlling the system can prevent it starting more frequently than recommended by the manufacturer. This can be achieved by a rack of multiple compressors or using variable-speed compressors;
- (h) Systems whose circuits have split evaporator coils need each coil to have equal access to air, to prevent the circuits flooding and risking liquid returning to the compressor. Ensure air flow is balanced, by paying attention to the system's proximity to walls and other equipment; and
- (i) Ensure the manufacturer will maintain a supply of key parts, including control boards, for the unit's expected lifetime.

## 7.7 Compliance and standards

### 7.7.1 Electrical safety

All HTHP systems shall be electrically safe; they shall comply with the Electrical (Safety) Regulations that are current when the system is installed.

Residential and light-commercial HPWHs shall comply with AS/NZS 60335.2.40, and a test report shall be made available on request.

Commercial HPWH that are not marketed for household use shall be assessed to ensure they comply with AS/NZS 60335.2.40 or AS/NZS 5149 series.

Systems that incorporate flammable refrigerants (A2, A2L, or A3) shall comply with AS/NZS 60079.0:2019 or AS/NZS 60335.2.40.

### 7.7.2 Refrigerants

Refrigerants in AS/NZS ISO 817 and AS/NZS 5149, Parts 1 to 4, are classified on the basis of flammability and toxicity. The HTHP shall comply with the safety requirements for the relevant classification.

Many common refrigerants are A1. A1 is not flammable or toxic but has a high GWP rating. As the industry starts to use refrigerants with lower GWP ratings, it needs to make a trade-off with flammability. The A2L class was introduced to identify refrigerants that have a low GWP rating and low flammability, and which, therefore, require suitable safety controls. HC refrigerants are A3 class. They are highly flammable and require additional safety controls.

AS/NZS 60335.2.40:2023 provides a compliance pathway for HTHP that use A3 refrigerants, but which have similar site-specific safety controls to A1 and A2L refrigerants.

Pressure vessels for refrigerants shall comply with AS 1210 or an international code approved under AS 1210 (such as *Boiler and pressure vessel code*, Section VIII; BS EN 13445; or PD 5500). Alternatively, pressure vessels that comply with AS 2971:2007 can be used.

If the refrigerant is substituted, the contractor undertaking the change shall ensure that the system complies with the requirements for the substituted refrigerant. HPWHs are deemed to be electrically unsafe if the refrigerant is substituted, unless the HPWH is designed, or has been adapted, to operate safely with the new refrigerant.

### 7.7.3 *Heat-transfer medium*

If a heat-transfer medium (such as, hot water) is used, the pressure equipment used to contain the heat-transfer medium shall meet the Approved Code of Practice for Pressure Equipment (Excluding Boilers), if required by Health and Safety in Employment (Pressure Equipment, Cranes and Passenger Ropeways) Regulations.

### 7.7.4 *Physical protection*

HPWH's that comply with AS/NZS 60335-2.40, including products that incorporate A2L and A3 refrigerant, shall be installed so that the public cannot access them (they are usually protected by a cage or secured fence). Installations that cannot demonstrate they comply with AS/NZS 60335-2.40 shall comply with the site requirements of AS/NZS 5149.

### 7.7.5 *Contamination of potable-water supplies*

Heated-water systems shall be installed in accordance with AS/NZS 3500.4. Potable-heated-water heaters shall comply with AS/NZS 4020. They shall be installed in accordance with one of the *legionella pneumophila* control options in the NZBC, G12/AS2.

### 7.7.6 *Seismic design*

When appropriate, heat-pump installations, indoor heating and cooling fan coils, and radiators shall comply with NZS 4219.

## 8 Commissioning

### 8.1 General

The equipment installer shall provide a commissioning report for the purchaser as part of their installation contract. For plants > 50 kW, the commissioning report should be by an independent person.

The commissioning report measures capacity and COP over a range of conditions. It records the temperature and flow rate through the heat-exchangers, including any heat-exchangers associated with thermal storage. These values should match the system's design flow rates, which are specified in the equipment supply contract. Commissioning the system should a range of operating conditions, as wide as the prevailing climate allows. Here is an example of commissioning the system for space heating:

- (a) Cool conditions (an early morning start-up on a cold day, and running the system for at least three hours, or until equilibrium conditions are reached);
- (b) Warm conditions (a warm day and minimal heating demand); and
- (c) Typical conditions (mild climate and moderate heating demand).

Complete commissioning and system tuning can take several months to complete after the system's initial start-up and handoff. This process can be facilitated by remote monitoring and control.

The commissioning report fulfils several functions:

- (a) It determines that the flow rate through the heat-exchangers matches the system's design flow rates, specified by the manufacturer;
- (b) It records the flow rate through the heat-exchangers when the system is commissioned;
- (c) It confirms that all flow-control valves and variable-speed pumps in the distribution system are correctly configured;
- (d) It determines that the flow rates through the heating system are within the system's design specifications;
- (e) It records the temperature differential across each circuit in installations with a flow/return manifold;
- (f) It records the condensing temperature (the discharge pressure), evaporating temperature (the suction pressure), and compressor's capacity after three hours of operation, and references these recordings against the compressor's operating envelope (this is provided by the compressor manufacturer). The system's operating conditions shall be within the compressor's operating envelope and include conditional limits, such as compressor speed limits;
- (g) It measures the HTHP's capacity, power input, and COP after three hours of operation, and references these recordings against data supplied by the manufacturer;
- (h) It observes and reports on the compressor's operations under part-load heating conditions, in which multiple compressor systems are installed for a single stage. The manufacturer's stated minimum and maximum compressor speeds shall be observed during commissioning;
- (i) It observes the completion of a de-ice cycle during conditions that require it, or by replicating the conditions by reducing the airflow through the coil. Ensure there is sufficient water or thermal energy in the system to complete a de-ice cycle;
- (j) It uses data from the monitoring system to demonstrate that the system's control logic is operating to the stated design during the first month of the heating season;
- (k) It ensures the operation of a potable-water heating system, if present, is separate from the operation of the space-heating system;
- (l) It ensures the operation of a potable-water heating system, if present, does not compromise the efficiency of the space-heating system, or vice versa; and
- (m) It ensures the potable-hot-water system, if present, meets *legionella pneumophila* control requirements, such as those in the NZBC, G12/AS2.

A report on the system's operations at one month, three months and six months shall be provided. These reports can be generated using remote monitoring, if it is enabled. These reports include the following content:

- (a) The maximum and average supply-water temperature achieved while the HTHP and heating system are operated;
- (b) The average daily run hours per month, average weekly electricity consumption, and average monthly COP while the HTHP is operated;
- (c) Analysis of the suction superheat achieved by the system, especially events where low suction superheat coincides with low discharge superheat;
- (d) Analysis of the system's condensing pressure and discharge temperatures, referenced to the compressor envelope, and the temperature limits for the oil used in the lubrication system;
- (e) A fault report with details of what caused the faults and how they were resolved; and

- (f) Details of any post-commissioning adjustments that have been made to the HTHP or heating system.

## 8.2 Compliance and standards

Air-source HTHPs for water-heating systems shall be tested using the methodology in AS/NZS 5125. This methodology can be adapted to commercial air- and water-source HTHPs, by increasing the size of the water tank in proportion to the unit's heating capacity, or by selecting water-source temperatures to match the application conditions. The storage tank shall contain at least 50 L/kW of rated unit capacity and shall be insulated with a known heat-loss coefficient that has been tested in accordance with AS/NZS 4692.1:2005. Other systems should be tested using an equivalent methodology.

AS/NZS 5125 involves measuring the power input and thermal energy produced by the unit when coupled to a storage tank, under a range of standardised test conditions.

AS/NZS 4234 shall be used to estimate the unit's annual energy consumption and SCOP. Once the performance coefficients have been determined, by analysing the test results from the methodology in AS/NZS 5125 or an equivalent methodology, they can be entered into the heat-pump model of a thermal-simulation software package using AS/NZS 4234. The unit's energy use can then be compared with a reference heating system (for example, a boiler). The difference between the GHG emissions of two or more systems can be calculated using the carbon-emission factor for the energy that the system consumes. This information can be valuable when applying for a consent.

Variable-speed HTHPs shall be tested in accordance with AS/NZS 5125, or an equivalent methodology for non-air-source systems, using fixed compressor speeds of at least 100%, 75%, 50%, and 30%.

## 8.3 Remote monitoring

### 8.3.1 Capability to connect

The HTHP shall have the technical capability to communicate with an external device, such as a BMS. It shall allow this device to have the read and write parameters required to operate and monitor the HTHP. This PAS does not define which communication method and protocol to use; however, Modbus RTU, Modbus TCP/IP, and BACnet are commonly used by the industry. This PAS also does not define what level of access should be available to specific users, but this is an important consideration (see XX).

When the HTHP is purchased or installed, this technical capability to communicate does not need to be enabled or active. However, it shall be fitted, available, and capable of being activated without the HTHP or controller needing to be significantly changed.

### 8.3.2 Remote switching

The HTHP's control system shall allow the HTHP operations to be safely switched on and off via the remote connectivity system ('remote switching'). At a minimum, this may be implemented as voltage-free ('dry') contacts but may also include more comprehensive integration with the system.

The remote-switching capability should allow the heat pump to be stopped remotely if it is running, and be started remotely if it is idle. This PAS does not define who should have access to remote switching, but this is an important consideration (see XX).

The availability of remote switching may affect which electricity-supply contracts the consumer can negotiate.

### 8.3.3 Alarm reporting

The HTHP controller shall provide fault reporting or alarms through an external monitoring system (such as a BMS) or remote-monitoring service, or through audible or visual alerts.

### 8.3.4 Remote monitoring

HTHP systems shall have the capability to connect with a remote-monitoring service, that can provide off-site service support and diagnostics, or – if the consumer requires it – access to time-of-use pricing signals. The connectivity speed should be sufficient for monitoring, and the connection should have an up-time reliability of at least 95% over the HTHP's lifetime.

Remote monitoring that connects to the local area network (LAN) by an ethernet or Wi-Fi connection can encounter security restrictions, especially when two-way communication is needed to allow settings to be changed or faults to be resolved. An extra challenge with Wi-Fi is maintaining the connection over the lifetime of the unit. Wi-Fi connections are more appropriate in a residential context, where the user

can access the connection easily (for example, using a mobile phone application) and can re-establish the connection if it fails.

Remote access via the mobile network (such as, the 4G or 5G networks) enables two-way communication independent of a site's security restrictions. This also avoids the cost of establishing a connection where the HTHP is located. However, the connection cost needs to be maintained for the duration of the remote-access connection.

Remote access shall not rely on the 3G network, as this network has limited time left in service.

#### **8.3.5 Connectivity security and access**

The system that provides connectivity and remote access should allow access only to authorised users. It shall use accepted good practice that maintains privacy, integrity, confidentiality, and cybersecurity. This PAS does not define who authorised users are, but this is an important consideration.

In order to maintain an audit trail it is necessary to assign an individual user account to every user, record the edits made by each user on any system. Only authorised users shall be able to access specific monitored systems.

All communications between the site IT equipment and external IT infrastructure shall use predefined encryption techniques and keys, or a secure virtual private network (VPN) or structure that provides an equivalent level of security. The system shall also use a VPN, or structure that provides an equivalent level of security, to change software and settings.

The company that monitors and controls the system remotely shall use accepted good practice and comply with relevant security frameworks, guidance, and standards. The company should have these plans and policies:

- (a) A current business-continuity plan;
- (b) A relevant incident-response policy and plan; and
- (c) A disaster-recovery policy and plan.

Some systems that control HTHPs have the capability to measure performance and energy-usage data, and communicate or log the data. This can be useful to help quantify the benefits and cost savings of an HTHP.

The system that controls the HTHP may also have the capability to measure and record certain values, related to the heat pump's operations, that may help detect and diagnose faults. Alternatively, the system may be able to communicate these values to an external device (such as, a BMS) for logging.

### **8.4 Performance assessment and verification**

#### **8.4.1 Modelling and simulation**

Annual energy use and SCOP can be estimated by modelling the water-heating system (this includes the HTHP) using an adapted version of the methodology described in AS/NZS 4234 (see Appendix B).

Transient thermal-simulation software (such as TRNSYS or HTHPSimNZ) can be used to model the performance of a commercial HTHP application and determine what size of components a proposed system will need, and what its energy savings will be. Pre-monitoring the existing system, to determine the peak demand and demand profile, will enable the consumer to create an accurate simulation of the proposed system for the specific site. Thermal-simulation software requires characterising the performance of the HTHP according to the methodology described in AS/NZS 5125.

The difference in energy consumption between the existing system and the proposed system can be calculated by modelling both the existing and the proposed system. The impact of the proposed HTHP system on GHG emissions can be determined by applying emission factors to both estimates of annual energy consumption. The emission factors published by the Ministry for the Environment should be used for this purpose.

For each commercial HTHP a modelling report shall be produced, in accordance with AS/NZS 4234. The modelled system shall account for pumping energy used in the heated-water-distribution system, and operational controls logic employed by the system.

It is possible to undertake a representative simulation without expertise in thermal-simulation software.

#### **8.4.2 Daily heating demand**

When AS/NZS 4234 is applied to a commercial HTHP system, rather than using the domestic water-draw profiles defined in this standard, the daily heating-demand profile of the application shall be



estimated as a function of the time of day, climate conditions, and range of ways that the system will be used.

## 8.5 In-situ performance assessment

Ongoing performance monitoring is important. It allows deviation from the HTHP expected performance to be identified and diagnosed, and helps evaluate the site's, organisation's, or nation's progress towards goals, such as decarbonisation.

A system's energy performance can be determined in-situ, through datalogging or monitoring the energy usage and heat produced over time. In general, this requires power and flow meters, and temperature sensors to be installed on the individual HTHP. Some HTHPs can report power usage and flow rates from their internal controls.

It is important to consider what timesteps the data capture requires, to ensure it achieves the desired level of accuracy. This is particularly important when measuring potable-hot-water draw-offs from storage tanks when the duration of draw-offs is relatively short.

Remote monitoring allows data to be frequently checked for continuity, without accessing the site. This makes the data gathered more complete and, therefore, more useable. See 8.3 for more details about requirements for remote monitoring.

In-situ performance assessment allows degradation in the HTHP's expected performance over time to be readily identified and addressed through remedial measures.

The amount of performance monitoring that is stored and accessible to the system's owner should be sufficient to make meaningful performance comparisons between years, seasons, and sites. These performance comparisons shall include the system's power consumption and heat-energy production at least once every five minutes (time-averaged data).

### 8.5.1 Carbon accounting

The impact of an HTHP on a site's or business's GHG emissions should be assessed, to compare the HTHP's performance with the other heating option (e.g. the existing system). Both assessments should use the same weather data, and the latest emissions factors published by the Ministry for the Environment.

## 8.6 Specification

Potable-water heating shall be separated from space heating, so that the space-heating distribution network is not heated to meet local potable hot water demand.

Potable-water-heating systems shall be single-pass systems with a design capacity of more than 5 kW. If a ring-main is present, water flow from the ring-main shall be heated separately to the water in the main storage tanks. Installations shall still comply with the *legionella* control requirements in the NZBC, G12.

## 9 Application: Commercial potable-water heaters

### 9.1 General

Commercial HPWH for potable-water-heating applications are normally split units with a capacity of more than 15 kW, which are designed for medium-to-high operating hours. They are manufactured in lower volumes than domestic units, and to a higher price point. Their design life is more than 15 years, and they are generally repairable. Units with larger capacity may be covered by a service contract, especially when a facility needs a continuous hot-water service to operate. A backup heating system is commonly part of the installation.

Most commercial HPWH are air-source; however, water-source units are available.

Commercial hot-water loads can also be delivered by connecting several integrated, low-capacity split units together in parallel. This approach provides increased redundancy but, in general, the design life of each unit is shorter than that of a commercial HPWH.


Most systems involve a reticulated ring-main, so this shall be considered when the installation is designed, especially when multiple units are connected.

### 9.2 Technologies available

#### 9.2.1 Single-pass units

Single-pass units use R32 or CO<sub>2</sub> as their refrigerant.

Single-pass units are particularly suited to commercial applications (see Figure 7). One of their main advantages is the storage tank heating from the top down. This allows the tank to function as a buffer tank, producing hot water in real time to help meet the peak demand load. This reduces the volume of hot-water storage required and provides rapid recovery if the water supply is fully depleted.

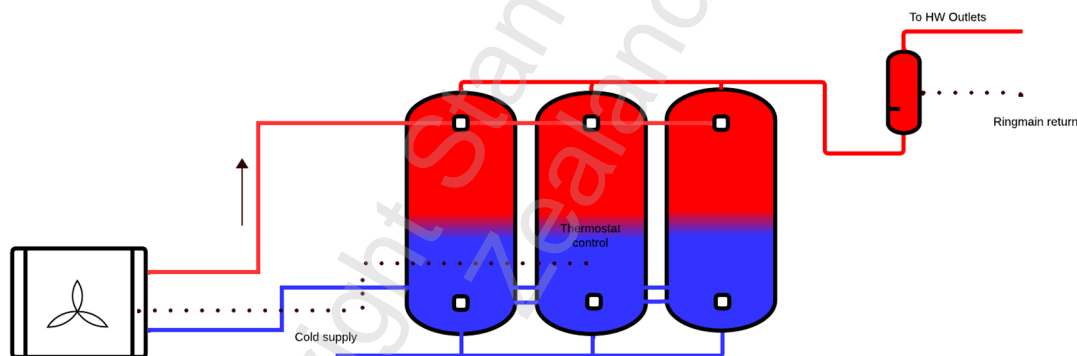


**Figure 7 – Schematic of a stratified storage tank and single-pass HTHP system**

#### 9.2.2 Multi-pass units

Multi-pass units come in a range of configurations and use a range of refrigerants.

Multi-pass units that have a larger capacity require a high flow rate between the heat pump and the tank (see Figure 8). This often results in these systems having poor thermal stratification and slower recovery if the water supply is fully depleted.

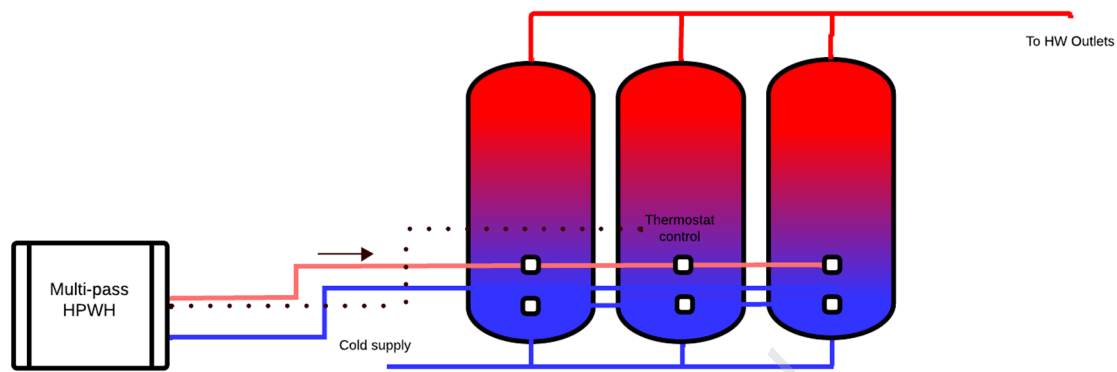

**Figure 8 – Schematic of a storage tank and multi-pass HTHP system**


### 9.3 Tank connections

Commercial systems often need multiple tanks to be connected, to meet the required volume of stored hot water. The tanks can be connected in parallel, or in series. Parallel connection is the preferred connection for single-pass systems. It reduces the flow velocity through each tank, which establishes and maintains more stable thermal stratification. With a parallel connection, it is essential to observe the 'first in, last out' principle for hot and cold water, heat-pump flow, and return connections. Flow-balancing valves should not be relied on.

If the layout of the tanks prevents the flows being properly balanced through the tanks, connect the tanks in series. Tanks connected in series have less stable thermal stratification, due to higher flow rates through each tank.

### 9.4 Reticulated systems

Reticulated (ring-main) systems should be carefully integrated into the hot-water system (see Figure 9) to maintain thermal stratification in the main storage tank(s). The water returning from the reticulation system shall not be connected to the base of the main storage tank. Instead, a separate zone within the main tank, or a standalone tank, should be used to reheat this water, as this allows the main storage tank to remain stratified.

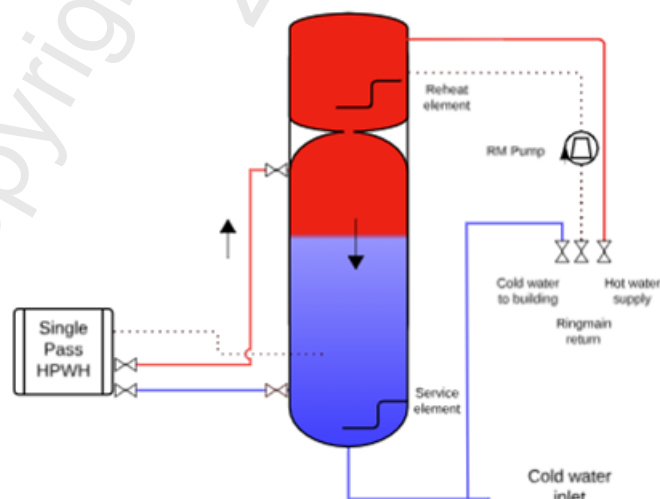

**Figure 9 – Schematic of single-pass HTHP with an integrated ring-main reheat system**

### 9.5 Heat-exchangers



Commercials systems produce a considerable volume of hot water, and the choice of heat-exchanger will affect the unit's lifespan. Plate heat-exchangers are very effective initially, but they are prone to fouling over time. Alternatives (such as, tube-in-shell, and co-axial heat-exchangers) are less prone to fouling and more likely to maintain the unit's efficiency for longer periods of time. When plate heat-exchangers are used, they should be readily removable, should they need to be replaced. They can be removed by using refrigerant isolation valves on either side of the heat-exchanger, and mac-unions on the water connections.

It is particularly important to choose a heat-exchanger carefully, if it will be used in an area whose water contains dissolved calcium carbonate or other minerals. The process of heating water decreases the solubility of dissolved minerals, which leads to them being deposited on the heating surfaces.

Single-pass HPWH that operate with R32 and CO<sub>2</sub> refrigerants are available for commercial use. It is likely that HC-based units and hydrofluoroolefin (HFO)-based units will become available in future.

## 9.6 Multi-residential heated-water systems

Multi-residential buildings suit a centralised heated-water system, that distributes hot water to each residential unit. This system takes advantage of the diverse hot-water demand from multiple residences, which makes the HTHP system more cost-effective than would be possible otherwise.

In a multi-tenant residential development, a centralised potable-hot-water system has significant benefits over individual water-heating systems:

- (a) It is easier and more convenient to maintain centralised plant;
- (b) It increases the amount of useable space in each unit;
- (c) It reduces the risk of water leaks and equipment failure in each unit;
- (d) The operating costs are significantly lower than those of individual systems; and
- (e) The capital costs are significantly lower than installing an individual HTHP in each unit.

This system suits a centralised billing system with remote monitoring. The hot-water usage can be determined by installing a water meter in each unit. The electricity usage of the ring-main reheat is metered separately.

The advantages of single-pass HTHPs also apply to these systems. The quicker heat recovery means that less water-storage volume is needed to meet peak demand.

It is important that reticulated systems are carefully designed, to avoid excessive thermal losses and maintain the thermal stratification of the storage tank.

## 9.7 Performance assessment

There are two main ways to test the performance of HTHPs for domestic water-heating applications.

- (a) **Tapping Load test:** This method, described in AS/NZS 5125, EN16147:2017 and ISO 19967-1:2019, tests an integrated HTHP and storage tank. In this test, a water heater is installed to operate in stated environmental conditions, and hot water is drawn from the tank on a fixed schedule. The increased energy content in the drawn-off water is compared with the energy used to produce it. This provides a COP for the test period. The Tapping Load test includes the interaction between the HTHP and storage tank in the results; and
- (b) **Quasi Steady State method:** This method, described in AS/NZS 5125, measures the COP and capacity of an HTHP when it heats a mixed tank under different test conditions, to determine coefficients for a performance curve. The coefficients from the performance curve are inputted into a thermal-simulation software package (such as TRNSYS), to provide SCOP estimates.

It is inappropriate to use space-heating HTHP standards (such as, ISO 19967-2 or the EN14511:2018 series), because they do not take into account how the tank interacts with the unit's performance.

Currently, few commercial HTHPs have been specifically tested for domestic water-heating applications, as their capacity exceeds the STC Scheme's requirements in Australia. There are also no test facilities commercially available in Australasia that have the capacity to test these units. Units sold in Europe may have been tested using the Tapping Load methodologies in EN16147:2017 or ISO19967-1:2019.

The preferred alternative approach to the Tapping Load methodology is to use a modified version of AS/NZS 5125 and AS/NZS 4234 as outlined in Appendix B.

## 9.8 Determining demand

Potable-hot-water systems shall be tested as described in AS/NZS 5125 and AS/NZS 4234, which choose a water-draw profile that is a close match to the actual draw pattern. Commercial buildings are likely to have a higher draw flow and different timings than domestic residences. The heated-water demand from a centralised heated-water system for a multi-residential building is typically flatter than normal, due to the diversity of water usage by residents.

When using published hot-water-demand tables, take care that the demand is not overstated. This can happen when the published demand is intended for calculating system size, rather than representing likely actual demand. The outlet type, and installation's water pressures also need to be considered.

## 10 Application: Space heating

### 10.1 Commercial space-heating systems

Many commercial space-heating systems use a boiler to provide heating via hydronic circuits in the building. These systems are generally configured as a primary/secondary hydronic system. Piping networks distribute the heated water around the building. Radiators, fan coils, air-handling units (AHU), or underfloor heating pipes deliver heating into the building's spaces.

Some systems, particularly recent installations, are designed for condensing boilers to operate at moderate temperatures. However, most are designed to operate at the conventional-boiler return-water temperature of approximately 70°C. Non-condensing boilers require this return-water temperature to prevent corrosion caused by exhaust gases condensing.

In general, air-source HTHPs cannot match the boiler's existing return-water temperature, unless they are specifically designed to do so. To successfully apply an HTHP to these applications, the system as a whole should be considered.

### 10.2 Refrigerants

Air-source commercial space-heating systems generally require the HTHP to deliver the required water temperature during the coldest time of the year, and remain efficient despite relatively high return-water temperatures. Refrigerants that allow higher supply-water temperatures are less effective during low ambient conditions. Currently, the most appropriate refrigerant is R32, or similar blends. R32 supports a supply-water temperature of 55°C in typical New Zealand conditions.

Propane commercial HTHPs are likely to become more readily available. They provide a supply-water temperature of 65°C to 70°C. CO<sub>2</sub> HTHPs are generally not suited to space-heating applications, unless the return-water temperature can be controlled to stay below 35°C to 40°C.

### 10.3 Temperature

#### 10.3.1 *Temperature of the heat source and heat sink, and the return-water temperature*

Similarly, the heat source with the warmest possible temperature should be used.

The return-water temperature (or the temperature of an alternative heat-transfer fluid, such as glycol) back to the heat pump is an important design consideration for many HPWHs. A heat pump is generally more efficient when the temperature differential (the difference between the supply and return temperatures) across the heat-exchanger is greater. This is especially the case for CO<sub>2</sub> heat pumps, which require a relatively cool return-water temperature to maintain high heating capacity and high efficiency.

The temperature of some heat sources (such as, ambient air) varies according to the season and time of day. Therefore, the energy-efficiency of an installed HTHP may vary, according to the conditions. However, a properly specified and configured HTHP should provide heating at the desired temperature despite changes to the heat-source temperature.

HTHPs that use ambient air as the heat source for space heating will be most heavily constrained on cold days when the heating demand is also high. Overall, the system should be designed to perform in these worst-case conditions. However, rather than sizing the HTHP for these conditions, it can sometimes be more cost-effective to use a smaller HTHP with an auxiliary heating system (such as an electric resistance heater) or thermal storage (that is, a hot-water tank). This solution means using the HTHP alone on most days and supplementing it with the auxiliary heating system on extreme-temperature days.

For some commercial and industrial space-heating situations, other heat sources (such as wastewater, geothermal, or heat from other processes) may be available. Typically, these sources may be warmer than ambient air and vary less between seasons. Using these sources as the heat source may provide higher annual performance (SCOP) than using ambient air.

### 10.4 Operational considerations

HTHPs that use ambient air as the heat source for space heating will be most heavily constrained on cold days when the heating demand is also high. Overall, the system should be designed to perform in these worst-case conditions. However, rather than sizing the HTHP for these conditions (this would result in an oversized heat pump for most of the time), it can sometimes be more cost-effective to use a smaller HTHP with an auxiliary heating system (such as an electric resistance heater) or thermal

storage (that is, a hot-water tank). This solution means using the HTHP alone on most days and supplementing it with the auxiliary heating system on extreme-temperature days.

### 10.5 Pipe size restrictions

When replacing a central-heating plant, the existing secondary-system pipe sizes may constrain the design options for a heat pump. Increasing the temperature differential across the secondary system may be a way to re-use existing pipework (this reduces the circulation flow rates). Another alternative is using a variable-flow-rate system design. This approach increases the flow and pump power during high heating-demand periods, but reduces the pump power for the rest of the time.

### 10.6 Whole-of-life analysis

A whole-of-life analysis shall be completed to compare different HTHP options and configurations with alternative systems. At a minimum this should include analysing and comparing direct and indirect emissions, capital costs, energy use, maintenance costs, and end-of-life costs. Ideally, it also considers the environmental impact of different options and configurations.

### 10.7 Performance standards

For space-heating applications, the HTHP unit's SCOP shall be greater than 3.0 for all climate zones. For heated-water applications, the SCOP shall be estimated by modelling, using AS/NZS 4234 or a similar methodology, such as Steady State capacity and efficiency testing of the HTHP on an input/output basis.

### 10.8 Temperature differential

The system modelled using AS/NZS 4234 shall achieve an appropriate temperature differential across the HTHP, when it is operating. The system design should maximise the opportunities for refrigerant sub-cooling.

### 10.9 Thermal storage

When thermal storage is used, it shall be thermally stratified to achieve an appropriate temperature differential across the HTHP, when it is operating.

The thermal storage shall have sufficient capacity to meet the heating demand for the application for at least 30 minutes in the 5% worst weather conditions experienced at the location, and at the times when the heating is most likely to be used.

When thermally stratified storage is integrated into a heating system, the storage tanks can be distributed or centralised. All thermal storage that operates at more than 50°C shall be insulated with an insulation R value of at least 1.67 m<sup>2</sup> K<sup>-1</sup> W<sup>-1</sup> (equivalent to 50 mm of high-density polyurethane foam)<sup>1</sup> for tanks whose capacity is less than 5000 L, or an R value of at least 3.33 m<sup>2</sup> K<sup>-1</sup> W<sup>-1</sup> (equivalent to 100 mm of high-density polyurethane foam) for tanks whose capacity is 5000 L or more.

### 10.10 Fluid distribution

If present, the fluid-distribution system shall be a variable-flow distribution system. All fluid (such as, water) that returns to the HTHP shall pass through a heat-exchanger (such as, a radiator or fan coil) before it returns to be reheated.

### 10.11 Minimum temperature for space heating

When the application is space heating for occupancy, the room temperature in the 5% worst weather conditions experienced at the location shall be at least 20°C within 15 minutes of being occupied.

### 10.12 Pump efficiency

When pumps are needed with a power-consumption rate of more than 200 W at maximum capacity, their motor efficiency shall be more than 70%. EC motors are an example. This requirement also applies to pumps replaced as part of a retrofit or upgrade project. Pumps whose power-consumption rate is more than 200 W shall operate under constant pressure control, when centralised capacity control is not enabled. When it is practical to do so, temperature compensation shall be applied to limit pump pressure in mild heating conditions.


### 10.13 Fluid-distribution pipe insulation

<sup>1</sup> This assumes the polyurethane foam has thermal conductivity of 0.03 W m<sup>-1</sup> K<sup>-1</sup>.

All fluid-distribution pipes shall be insulated by a minimum of 30 mm of closed-cell, foil-faced (or equivalent) pipe insulation. Pipe insulation that will be degraded by sunlight shall not be used in exterior locations.

#### 10.14 Retrofit constraints

When an HTHP is retrofitted to an existing system (such as, radiators), the existing system may not have sufficient capacity to maintain room temperature, during low ambient conditions, at the lower water temperature that the HTHP provides. This problem can be overcome with additional air-heating heat-exchangers in the space (such as, a water-to-air fan-coil unit). The preferred energy source for these extra heat-exchangers is the return water line back to the HTHP or storage tank in the water-heating system (refer Figure 10). These extra heat-exchangers shall be controlled to operate only when required.

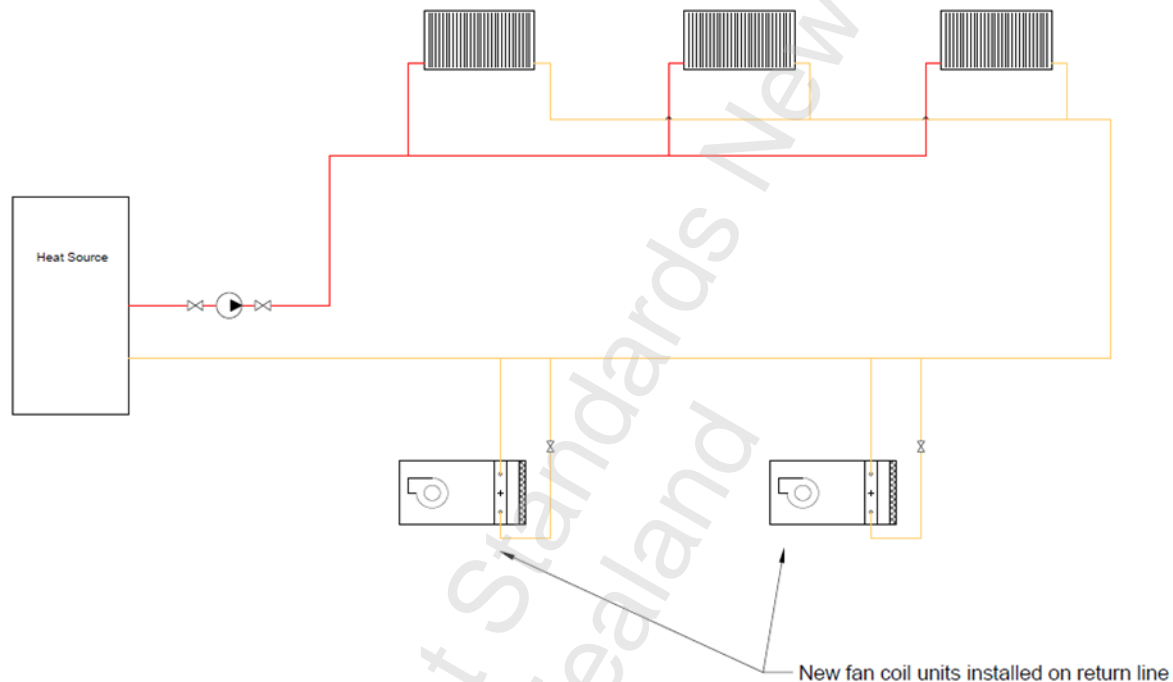

**Figure 10 – Schematic showing use of additional heat-exchangers for space-heating**

#### 10.15 Provision of cooling

When an HTHP removes heat from the heat source (to deliver it to the heat sink), cooling happens at the heat source. This can be used by the heat pump to provide cooling. In general, providing cooling increases an HTHP's capital cost. It may also reduce the energy-efficiency of its heating, if the heat source is operated at a colder temperature to provide cooling. However, it removes the need for a separate refrigeration system.

When the cooling and heating demands are very different, the choice of HTHP should be based on delivering the lower demand. The remaining demand should be met by a separate HTHP, for heating, or a refrigeration system, for cooling.

Cold pipework should be insulated. If cooling occurs at temperatures below the dewpoint, condensation on cold pipework and cold parts of the heat pump should be prevented from causing damage.

Three main cases occur that involve different relative timings of the cooling and heating applications:

- (c) When **cooling and heating occur simultaneously**, the fluid cooled in the heat source is simply the cooling application. Alternatively, a cold secondary fluid (such as, chilled water) can be pumped to the cooling application;
- (d) When **cooling and heating occur within hours of each other** (for example, in alternating shifts), thermal storage should be provided on the heat-source side or heat-sink side, or both. This allows cooling produced during the 'heating shift' to be stored for use during the 'cooling shift', and vice versa. If cold storage (such as, a chilled water tank) is used, it should be stratified; and
- (e) When **cooling and heating occurs in different seasons** (for example, summer and winter), in the cooling season the heat-source side of the heat pump can be configured to cool a fluid, and the



heat-sink side can be configured to dump the rejected heat into ambient air or another heat sink. This is achieved by configuring the heat pump so that the evaporator and condenser heat-exchangers switch roles (that is, the heat-source heat-exchanger is switched to the heat-sink heat-exchanger, and vice versa), or by configuring the external plumbing, so that different fluids are sent to the heat pump during different seasons.

When heating and cooling occur simultaneously, or when thermal storage allows heating or cooling to be moved between time periods, an effective combined COP ( $COP_{combined}$ ) can be calculated using Equation 1.

$$COP_{combined} = \frac{Q_{heating} + Q_{cooling}}{P} \dots\dots\dots (Eq. 1)$$

## 10.16 Scope and benefits of advanced controls

### 10.16.1 Considering the installation as a complete system

It is often possible to significantly improve the efficiency and reliability of HPWH by considering the installation as a complete system instead of a standalone heat source. When the temperature of water supplied by the heat pump is lower than that of a previous space-heating system, converting the distribution system from a primary/secondary system, to one with a variable flow rate that matches the heating demand, can more effectively use the HTHP's lower water temperature. It may also be necessary to install additional heat-exchangers to meet the required room temperatures.

### 10.16.2 Capacity control

Variable-capacity installations allow an HTHP's heat output to be matched to demand. The heat pump's capacity is adjusted by changing the compressors' motor speed (this is usually done via an inverter) or adjusting the number of compressors operating (this applies to installations with several compressors).

During part-load operation, speed-control systems are more efficient than most other systems. Other ways of controlling the capacity of fixed-speed compressor systems include digital scroll compressors, hot-gas bypass systems, and slide valves on screw compressors. These methods are effective at controlling capacity but are less efficient than speed-control systems.

Instead of variable-speed control, capacity can be controlled by limiting the maximum compressor speed or reducing the water flow through a variable-flow heating system.

Unlike boiler-based systems, the efficiency and operating temperatures of an HTHP are affected by the return-water temperature into the unit. In general, the lower the temperature of the heat sink entering the heat-pump-to-heat-sink heat-exchanger, the lower the operating pressure of the unit and the more efficient it will be. Reduced operating pressure also results in the refrigeration system being less stressed and more reliable. In periods of low heating demand, the return-water temperature can be warmer. This reduces efficiency, so the system should be designed to avoid this.

Using buffer tanks to prevent compressor short-cycling and provide a source of energy for defrost cycles should be carefully considered. In highly dynamic installations, a buffer tank can be installed on the return heat-sink fluid loop to the heat pump, to smooth temperature changes and improve control.

When thermal storage needs to be included in the system, consider the hot-water temperature when the system is designed. Thermal stratification (see 5.2) is effective and recommended; however, other configurations can be considered. Under part-load conditions, the thermal store should not result in small temperature differentials across the HTHP.

### 10.16.3 Pump control

In conventional-boiler installations, any excess water flow through the heating system, beyond what is needed to meet the heating demand, is diverted past the heat-exchanger, and back to the boiler (this is often called a 'bypass'). When an HTHP is retrofitted to an existing system that was operated at a higher circulation temperature than the new system will be, the system shall be converted to a variable-flow distribution system.

A variable-flow distribution system is designed to deliver the required amount of heated water to the heating outlets to meet demand. All water circulating within the distribution system is passed through a heat-exchanger (such as, a radiator, fan coil, or underfloor heating circuit) before it returns to the HTHP or thermal-storage tank.

Diverting valves should be set in the fully open position (that is, no diversion), and the flow rate should be controlled with variable-speed pumps. Alternatively, when existing fixed-speed pumps are retained, variable-speed drives (VSDs) can be installed to control the water flow through the system. Pump

speeds will either be centrally controlled to meet the building's heating and cooling demand, or controlled to a constant pressure. When flow-control valves are deployed, constant pressure control allows the pump speed to be varied according to the total amount of water flow delivered to the heating or cooling outlets. Flow-control valves can be binary on/off valves (such as those on a radiator) or variable-flow valves (such as a motorised ball valve).

### 10.17 Estimation of required heating capacity

It is important to accurately estimate the required heating demand, so that the system that is designed and installed is fit for purpose. Heating-demand requirements should be calculated by an independent professional – not usually the installation contractor. Online calculators are available for space heating.

Consider these parameters to get an accurate estimate of the heating demand for space heating:

- (f) The size and number of spaces to be heated. Note the floor areas and room volumes;
- (g) The construction of the floors, walls, and ceilings, particularly the overall insulation values;
- (h) The area of windows for each space. Note whether the windows are double or triple glazed, what type of frame material is used, and how they are constructed (this includes any thermal breaks), as these features affect the R value of the window; and
- (i) The estimated air infiltration or leakage for each room, or ventilation quantity ( $\text{m}^3 \text{s}^{-1}$ ) for each space if the space has a separate ventilation system.

For a retrofit application, existing monitoring data of the heating demand can be used, if the data is reliable. Monitoring equipment can be installed before any proposed new HTHP is considered. Monitoring of an existing installation should separate the energy supplied from the heating unit from the energy supplied to occupied spaces or applications, so that distribution heat losses can be estimated. When a proposed new installation includes changing the distribution system, the effects of these changes should also be measured by the monitoring data collected.

### 10.18 Compliance and standards

Regulators are currently assessing HTHP units, to include them in the New Zealand Government Minimum Energy Performance Standards (MEPS) regulatory framework. The MEPS regulatory framework has been used for 20 technologies since the early 2000s and has saved New Zealand consumers more than \$1.3 billion in avoided electricity costs.

Although HTHP technology is acknowledged as being very energy-efficient, including it in the MEPS regulatory framework will set a minimum efficiency 'floor' in the market. This will ensure the technology meets the claimed performance levels, giving consumers confidence that their investment will perform to an acceptable level.

MEPS are typically based on local, trans-Tasman, or international standards. When technology has been tested to the standard approved by the national body (Standards New Zealand), it can be relied on to perform as claimed.

The Energy Efficiency and Conservation Authority operates a comprehensive programme that checks technology meets the minimum requirements in the MEPS regulatory framework.

### 10.19 Seasonal coefficient of performance

A heat pump's COP depends on the operating conditions. Therefore, the COP can be quite different at different times of the day or in different seasons. Different operating conditions affect the heating demand, the heat pump's heating capacity, and the heat pump's power requirement.

The SCOP measures the annual average COP. It is weighted by heating capacity, heating requirements, and operating hours. When calculating SCOP, make sure consistent units are used for the quantities in the SCOP equation, and that they come from the same period.

The seasonal energy-efficiency ratio (SEER) is the annual average COP. It takes cooling capacity, cooling requirements, and operating hours and conditions into account (see Equation 2). The term 'SEER' is used by the refrigeration industry but, for heat pumps, it is the same concept as SCOP.

$$\text{SEER} = \frac{\text{annual } E_{\text{heating}}}{\text{annual } E_{\text{electrical}}} \dots\dots\dots (\text{Eq. 2})$$

Where

$E_{\text{heating}}$  = the total energy supplied to the heat sink by the HTHP (kWh) over the period



$E_{\text{electrical}}$  = the total electrical energy consumed by the HTHP (kWh) over the period

To size the capacity of a HTHP's design, the COP and thermodynamic efficiency relative to Carnot cycle should be evaluated for the application's typical operating conditions and for more extreme conditions.

Typical operating conditions should be used to evaluate the thermodynamic efficiency relative to Carnot (see Appendix C1). If the typical heating requirement is less than the installed capacity, the COP should account for performance at a part load, or the effect of other control strategies (such as, thermal storage).

## 10.20 Performance monitoring

Ongoing performance monitoring of a system identifies and diagnoses any deviation from its expected performance. It also provides empirical evidence to evaluate the site's, organisation's or nation's progress towards goals, such as decarbonisation.

The amount of performance monitoring that is stored and accessible to the system's owner should be sufficient to make meaningful performance comparisons between years, seasons, and sites. These performance comparisons shall include the system's power consumption and heat-energy production at least once every five minutes (time-averaged data).

Depending on the application, other variables should be recorded to characterise the system's performance. These variables may include the supply and return temperatures and delivered flow rate for a hot-water-heating application.

The connectivity system should have the capability for remote monitoring (see 8.3).

## 10.21 Case study: George Manning Lifecare

George Manning Lifecare is an 88-bed facility in Christchurch that provides hospital care. Its domestic hot-water system comprised an 8000 L thermal store heated to 80°C, using 100 kW of resistance heating controlled to night-rate electricity tariffs. The original ring-main had a 'push pump' on the reticulated loop, which had been removed, and a circulator had been added to the return. A newer wing of the facility had a separate reticulation circuit with a circulator on the ring-main return. The facility experienced an erratic hot-water supply to the outlets.

The facility's space heating was provided by a 400 kW diesel boiler in a conventional primary/secondary heating system. It had wall-mounted radiators throughout the building that operated on two circuits. It also had fan coils in the ceiling, connected to a third heating circuit, which provided tempered fresh air. The primary circuit operated at 70°C to 80°C throughout the year. In the previous 12 months of operation, the site had consumed \$168,000 of diesel. In the previous two years, the boiler had incurred service and maintenance costs of \$80,000.

George Manning Lifecare undertook a decarbonisation project, which involved two stages. In the first stage, two 1000 L thermally stratified domestic hot-water cylinders were installed. A 50 kW single-pass HTHP was installed to provide the hot water. The reticulation-circuit return lines were joined together and reheated outside the main storage tanks. This meant the thermal store could be decommissioned, which freed up 85 kW of electrical capacity.

In the second stage, four 90 kW variable-flow HTHPs were installed, controlled by a multi-compressor load-management controller. The heating-distribution system was converted to a variable-flow system that operates at 55°C. Variable-speed EC pumps were installed to replace the existing fixed-speed pumps, and all bypass paths were closed. Upgraded fan coils were installed in the existing ventilation-system ductwork.

The in-control remote-monitoring system allows the system to be tuned in-situ and can determine the system's real-time energy performance.

In the 12 months since the project was completed, the electricity savings from removing the thermal store and reconfiguring the domestic hot-water system have fully offset the cost of additional electricity usage from the space-heating system. The project has reduced the site's annual energy costs by over \$170,000. Excluding the maintenance costs of the diesel boiler, the payback period is 3.2 years. Reducing the heating water temperature from 80°C within the primary circuit, to 55°C as a variable-flow system, has had no noticeable effect on the site's indoor temperature.

## 11 Application: Pool heating (commercial)

Commercial pools typically contain multiple pools within the complex, each heated to a different temperature, and of different sizes. The water within each pool is kept separate from the other pools, requiring separated plantroom equipment. The pool water is usually chlorinated, which is corrosive to some metals typically used for heat-exchangers.

Where previously heated via a boiler, the heating system typically incorporates a primary circuit supplying heat to each of the individual pool heat-exchangers. Water from each pool is pumped through the secondary side of each heat-exchanger. Control of the individual pool temperatures is achieved by controlling the primary circuit flow rate through each individual heat-exchangers.

Indoor pools also require that the indoor temperature and humidity are controlled to prevent condensation occurring within the building structure by high levels of fresh-air ventilation. An Air Handling Unit (AHU) with heat recovery preheats the incoming air using the energy contained within the exhaust air. A common alternative approach is the Run Around system, which uses a water loop to extract heat from the exhaust air to preheat the incoming fresh air. Both AHU and Run Around systems require a heating coil to supplement the energy recovered to maintain the required indoor temperatures. Smaller pools may use resistance supplementary heating. Most larger pools with use a heating coil connected to a water heater to supply this energy.

HTHPs are ideally suited to replacing a resistance or fossil fuel heating system for commercial pools as the water temperatures required are well within the range for efficient operation. There are two main approaches.

- (j) Direct heating. This approach directly heats the pool water within the heat-pump unit. Each pool requires a separate heat-pump water heater. A titanium based heat-exchanger is used within the heat-pump unit.
- (k) Indirect heating. This approach retains the primary circuit, and heats the water via the individual heat-exchangers external to the unit. The separation of the refrigeration system from the chlorinated water from the pool decreases the risk of contamination of the refrigerant circuit with water.

Traditionally the direct heating approach provides the lowest operating cost, but requires a higher installed capacity as each heat-pump unit can only heat its associated pool. A separate unit is also required for providing heating to the AHU or heating coil.

A more recent development of variable capacity multi-compressor HTHP overcomes the efficiency limitation of the indirect approach by controlling the flow rate through each heat-exchanger while eliminating the bypass path. A higher efficiency is achieved by lowering the return-water temperature to the HTHP, particularly during part-load operation. This approach also has the advantage of greater redundancy and diversity, allowing a significant reduction in total installed heat-pump capacity and electrical capacity.

## 12 Application: Fresh-air tempering

Fresh-air tempering systems are well suited for conversion to HTHP. It is important to ensure that there is sufficient energy available to complete a coil de-ice cycle during low ambient conditions.

## 13 Industrial process heat

### 13.1 Process heating

Process heating refers to heating uses on an industrial manufacturing site, including food-industry sites. Process heating often involves heating utility fluids (such as, hot water, steam, or hot air) that are used as a secondary fluid to transfer heat to an application. However, it can also involve directly heating a process fluid.

Understanding the heating-demand load profile is critical to designing the right size of HTHP system. Compared with the heating demand on residential or commercial systems, the process-heat demand on industrial sites is often larger in scale, and involves higher temperatures and significantly longer run hours. Industrial process-heating demands are influenced by the process's production levels, rather than the ambient temperature. As well as being large scale, process-heating loads can be relatively steady across an operating shift(s).

HTHPs for industrial use are typically much larger than commercial systems, and usually integrate the heating demand across several processes. Consequently, industrial HTHPs are often use a bespoke design rather than pre-configured equipment. The process of designing an HTHP for industrial use should be overseen by a qualified process engineer.

### 13.2 Space heating

Industrial settings sometimes require space heating. This can be delivered by a separate HTHP system, following the guidelines for commercial space heating (see 10.1). Alternatively, industrial space heating can be treated as another heat load for the application and delivered by the HTHP system that provides process heating. The choice depends on three factors:

- (l) **Coincidence:** Are space heating and process heating required at the same time;
- (m) **Locality:** Are space heating and process heating required in the same area of the manufacturing site, or will a secondary fluid be pumped a long distance; and
- (n) **Temperature requirements:** Are the heat-sink temperatures for the space heating and process heating similar?

### 13.3 Heat recovery

HTHPs are generally more expensive than heat-exchangers, so heat recovery from heat-exchangers should be maximised before HTHPs are considered. At complex industrial sites, this usually involves conducting a pinch analysis (process integration) of heating and cooling needs. The HTHP is designed only to provide residual heating, and possibly meet cooling needs, after economic heat-exchangers are maximised. For a building, this may simply involve recovering heat from exhaust air or wastewater streams, to preheat incoming cold air or water.

### 13.4 Technologies available

#### 13.4.1 Ammonia heat pumps

Ammonia heat pumps can operate up to heat sink temperatures of about 95°C, using equipment rated to 60 bar. They are commonly configured as a high-stage system, using the heat rejected from an ammonia refrigeration plant (this heat is about 30°C) as their heat source.

The heat pump can be fully integrated with the refrigeration system, to avoid needing a heat-source heat-exchanger (that is, to use a multi-stage system). However, this approach can make it difficult to find lubricants that can operate across the full temperature of the refrigeration system and the heat pump.

An alternative option is having the heat pump as a separate system that is cascaded to the refrigeration system by a cascade heat-exchanger (that is, to use a cascade system). This avoids the problem of finding lubricants. However, it makes the heat pump less efficient, due to lower evaporation temperatures for the same refrigeration heat-rejection temperatures. Ammonia heat pumps can be used with the cascade approach, even if the refrigeration system does not use ammonia as the refrigerant.

Ammonia heat pumps can be configured to provide top-up heating (such as for a hot-water ring-main) or to heat the heat sink across a wide temperature range.

#### 13.4.2 CO<sub>2</sub> heat pumps

CO<sub>2</sub> heat pumps commonly provide heating up to about 95°C, but can provide heating up to about 120°C. They use equipment rated to 150 bar. CO<sub>2</sub> heat pumps operate in a transcritical cycle and can simultaneously provide refrigeration at temperatures as low as -15°C (that is, the heat source can be an application that needs cooling by refrigeration).

Due to the transcritical cycle, to be efficient, CO<sub>2</sub> heat pumps should preferably be used to heat the heat sink across a large temperature difference (such as, heating cold water to hot water in a single pass). The heating COP may not be as high as it is for subcritical heat-pump systems. However, if the refrigeration benefits are used, the combined COP will often exceed that of separate refrigeration and heat-pump stages or systems.

#### 13.4.3 Mechanical vapour recompression systems

Mechanical vapour recompression (MVR) systems are subcritical heat-pump systems that use water as the refrigerant. In New Zealand, they are most used for milk evaporators in an open cycle. In this application, the heat source is water evaporating from milk at 60°C to 65°C. The MVR produces steam at 76°C to 70°C, to heat the evaporator. Given the open cycle and small temperature lifts, an MVR COP can be higher than 20.

The main disadvantages of MVRs are that they operate at vacuum pressures (water evaporates and condenses at less than 100°C), and the compressors shall have a very large swept volume capacity (turbo-fan compressors are commonly used). MVRs can operate at much higher temperatures and pressures, but systems with this capability have only recently become commercially available. A multi-stage system with intercooling is probably needed to get high temperature lifts. This is because of water's refrigerant characteristics, as well as the availability of compressor technologies that are cost-effective to use with water as the refrigerant.

An MVR can be designed as a closed system, where the refrigerant – water – indirectly heats another fluid. However, for steam-generating heat pumps, open-cycle, water heat-pump systems are more likely to be used. In these systems, the discharge from the compressor is used directly as the heat sink.

#### 13.4.4 Technology direction

Heat pumps for temperatures above 100°C are starting to emerge, but they are not yet common commercially. To achieve these high temperatures with standard refrigeration and heat-pump equipment is likely to need different refrigerants to those used for temperatures below 100°C. At higher temperatures, refrigerants have to operate at very high pressures. Therefore, lower pressure refrigerants are likely to be used to achieve high temperatures. These refrigerants include water (R718), butane (R600), iso-butane (R600a), hydrochlorofluoroolefins (HCFOs) (R1224yd(E) and R1233zd(E)), and HFOs (R1336mzz(E) and R1336mzz(Z)).

For large-scale heating, using several smaller units in parallel is likely to be more feasible than using one or two large-scale units. This approach can take advantage of lower-cost equipment, reduce the refrigerant charge per unit (for example, if A1 refrigerants cannot be used), and control capacity simply and effectively.

### 13.5 Refrigerants

#### 13.5.1 General

Refrigerant is a critical element of an industrial heat pump. A refrigerant is referred to by an alphanumeric code (for example, R32), which indicates its chemical composition. Appendix 1 contains a list of some potential refrigerants, but this is not an exhaustive list. Talk to your supplier about which refrigerant is appropriate for your specific requirements.

#### 13.5.2 Environmental and safety issues

Many current refrigerants are HFCs. HFCs are potent GHGs that, if released to the atmosphere, contribute to climate change. These refrigerants are anticipated to become less readily available, due to international efforts to reduce their impact on the climate.

Some refrigerants are also hazardous due to their toxicity or flammability. The refrigerant installed in a heat pump shall be appropriately labelled and correct safety measures applied for its specific hazard level. See AS/NZS ISO 817:2016 for definitions of safety levels.

It is generally not advised to charge an HTHP with a different refrigerant to the one it was designed to use. Refrigerants of different safety classifications require different engineering controls, so charging an HTHP with a refrigerant that has a different safety class could be hazardous to people or property. Consult an appropriately qualified technician before doing this.

'Charge minimisation' means designing a heat-pump system to use as little refrigerant as possible. This practice can be cost-efficient and can mitigate some of the risks associated with using hazardous refrigerants.



When consumers select a refrigerant for their application, they are recommended to select the refrigerant with the lowest GWP practicable (at least  $\text{GWP} < 750$ ). If they use a refrigerant with hazardous qualities, they shall implement all the appropriate safety measures.

### 13.5.3 Refrigerant leaks

In a sealed HTHP unit, the refrigerant is designed to remain within the system. However, refrigerant leaks will occur if pipes or other components fracture, due to corrosion or metal fatigue from vibration.

Consumers should ensure they service their HTHP unit as specified by the manufacturer, and check that the service includes checking for potential refrigerant leaks. They should also carefully observe any change in the HTHP's delivery temperature or power consumption, as these may indicate a refrigerant leak.

## 13.6 Temperature

### 13.6.1 Temperature of the heat source and heat sink, and the return-water temperature

HTHPs operate most efficiently when the temperature lift between the heat sink and heat source is minimised. Where possible, the system should deliver the coolest possible water temperature, while still meeting the heating requirement. For example, if  $60^{\circ}\text{C}$  water satisfies the heating requirement, a heat pump that delivers  $60^{\circ}\text{C}$  water is more efficient than one that delivers  $70^{\circ}\text{C}$  water. Similarly, the system should use the heat source with the warmest possible temperature (for example, warm exhaust air from a dryer rather than colder ambient air).

The return-water temperature back to the heat pump is also an important design consideration for many HPWH. In general, a heat pump is more efficient when the heat-sink-temperature increase (that is, the water temperature increase across the heat-exchanger) is greater. This is especially the case for  $\text{CO}_2$  heat pumps, which require a relatively cool return-water temperature to maintain high heating capacity and high efficiency.

The following strategy can be used to minimise the temperature lift while also maximising the temperature increase across the heating side of the heat pump:

- (o) Determine the warmest heat source available. While this is often the ambient air, if waste heat sources are available, choose the warmest;
- (p) Investigate the heating requirement at the application, and select the coldest temperature that will meet this requirement (this is the heat sink). Together, steps (a) and (b) minimise the temperature lift; and
- (q) Configure the flow of the fluid to be heated on the HTHP's heat-sink side, so that it is heated to the required temperature – determined in step (b) – from the coldest possible starting temperature, without wasting the heat stored in reticulated systems. For reticulated hot-water systems, thermal storage with stratification achieves this. It is configured so that the coldest water in the thermal storage is sent to the heat pump, to be heated to the required temperature for the application. Step (c) maximises the temperature increase across the heat-sink side of the heat pump.

Process-heating systems are most heavily constrained when the heat source is at its coldest, and the heating demand is at its greatest. Carefully consider the schedule of the application's heat loads to determine the scenarios when the system will be most constrained.

### 13.6.2 Temperature constraints

To achieve high energy-efficiency, most HTHPs operate with the refrigerant condensing temperature well below the refrigerant's critical temperature. The critical temperature (see Table 1) is the upper temperature limit that most systems can provide at the heat sink.

Specially designed transcritical heat-pump systems can operate efficiently when the heat-sink temperature is at, or above, the critical point. These system configurations are common when  $\text{CO}_2$  (R744) is the refrigerant, but not when other refrigerants are used. Transcritical systems may become more common in future for HTHPs whose heat sinks have a very high or variable temperature.

The refrigerant boiling point at atmospheric pressure (see Table A1) constrains the temperature at the heat source. The refrigerant selected should have a lower boiling point, at atmospheric pressure, than the usual heat-source temperature. In most systems, the refrigerant boiling point sets the lower temperature constraint, based on what is practical for the heat source. Refrigerants with higher boiling points (these are sometimes called 'low-pressure refrigerants') are less dense as vapour at the heat-source temperature. They will, therefore, need compressors, heat-exchangers, and piping that are physically larger than high-pressure refrigerants would need at the same temperatures. Requiring larger equipment typically increases the capital costs associated with low-pressure refrigerants.

### 13.7 Determining demand

The demand from a process-heating application is determined by considering these factors:

- (r) The final (target) and initial temperature and heat load (kW) for each application; and
- (s) The expected schedule of heat load for each application, including any variation during operating shifts and between seasons.

The total demand during each shift, season, or other relevant period, is the sum of simultaneous heat loads that cannot be met by heat-recovery options (see 12.2). The HTHP system should be designed to meet the greatest demand.

Calculating the total demand should take account of thermal storage used to generate heat in low-usage periods for using later, which spreads the HTHP's operational period over a longer period than the heating demand. Therefore, when thermal storage is used, the total demand equals the average heating demand over the HTHP's operational period, rather than the peak demand. This is a feasible option when, for example, shifts with high heating demand are followed by shifts with low, or no, heating demand. This option can mean investing less capital in HTHPs to meet a larger demand.

If the demand during different shifts, seasons, or other relevant periods varies by more than 30%, consider installing multiple HTHPs, or one HTHP with multiple compressors that are fed by a common suction manifold. The size of the HTHP system should allow some compressors to be switched off during periods of low demand.

If some of the application's heat loads need a much higher heat-sink temperature (target temperature) than others, it may be more cost-effective to deliver the different temperatures with different levels of a multi-stage or cascade system. Alternatively, the high-temperature heat loads could be delivered by a separate HTHP.

When a site has cooling *and* heating demands, where possible, consider using heat pumps to provide cooling (see 10.15).

Heat-pump systems that use subcritical cycles are generally best suited to applications where the heat-source and heat-sink temperature changes are small, as they pass through the heat pump. Examples of suitable applications include generating steam or topping up the heat of a ring-main.

Heat pumps that use transcritical cycles are best suited to applications where the heat-sink temperature change is large. Examples of suitable applications include heating potable hot water from cold water for sanitary purposes, or heating air for process dryers.

A heat pump's heat source should be as hot as possible, to increase the heat pump's capacity and efficiency.

### 13.8 Factors affecting performance and durability

Process-heating systems often have a required duty, or level of service, that means they consistently run for long hours at relatively high load. This level of service can be higher than, for example, some heating, ventilation, and air conditioning (HVAC) equipment, which is required to run at near-peak output only for a few hours each year. Therefore, equipment for process-heating systems may need to be designed specifically for their level of service.

Industrial equipment may be designed with heavier duty motors, bearings, and gaskets, to ensure parts provide the expected level of service and avoid them failing prematurely. Discuss the system's design loads and expected run hours with equipment suppliers, to ensure the equipment they recommend will be fit for purpose.

The design for a system with multiple units, or a system that needs some redundancy, could include the ability to remove one unit from service, to repair or replace it, without affecting the operating ability of the remaining units.

The choice of lubricant used with compressors is critical, because of the high temperatures that HTHPs experience. It may mean using a different lubricant with the compressor than with a similar refrigeration compressor, to avoid the lubricant breaking down at the high temperatures. Equipment suppliers are generally responsible for selecting the right oil types and designing the right oil-cooling system for the agreed level of service. Oil-free compressor options are available, which avoid the need for lubricants; however, they can be less efficient than equivalent oil-lubricated compressors. Discuss lubricant options with the equipment supplier, before selecting equipment.

An HTHP's performance at an industrial site can also be affected by the temperature lift, inlet and outlet fluid temperatures, heat-exchanger (design and size), fluid (type, cleanliness and fouling), fluid flowrates, and heat source (temperature consistency).

It is usually best to design an HTHP system where the HTHP can run continuously to meet the production heat loads, and avoid it starting and stopping frequently.

### 13.9 Compliance and standards

Before installing a system, using performance-verification spreadsheet models and thermal-design tools (such as TRNSYS) can validate a proposed design and its likely energy savings. These tools are beneficial for commercial- and industrial-scale systems; they can optimise the installed capacity, configuration of thermal storage, and pump and electrical requirements.

### 13.10 Performance monitoring

Once a heat pump is commissioned, performance monitoring reviews and optimises its operations over a period, to establish its baseline performance. Ongoing performance monitoring of a system identifies and diagnoses any deviation from its expected performance. It also provides empirical evidence to evaluate the site's, organisation's or nation's progress towards goals, such as decarbonisation. Performance monitoring should include regularly reviewing how equipment is performing and whether relevant performance indicators are being met.

The amount of performance monitoring that is stored and accessible to the system's owner should be sufficient to make meaningful performance comparisons between years, seasons, and sites. These performance comparisons shall include the system's power consumption and heat-energy production at least once every five minutes (time-averaged data).

Depending on the application, other variables should be recorded to characterise the system's performance. These variables may include the supply and return temperatures and delivered flow rate for a hot-water-heating application.

Capability for remote monitoring should also be a component of the connectivity system (see 8.3.4).

### 13.11 Performance benchmarking

Process heating can be conducted in a wide range of operating conditions, so it is difficult to specify an absolute COP benchmark. When a high-temperature heat source is available, the COP can be very high. Conversely, when a large temperature lift is needed, the COP can be quite low. Therefore, the recommended performance benchmark is the Carnot cycle COP for the same heat-source and heat-sink temperatures. Appendix C explains how to calculate the Carnot cycle COP and thermodynamic efficiency relative to the Carnot cycle.

**In all design conditions, the recommended performance benchmark for the COP is a thermodynamic efficiency relative to the Carnot cycle of at least 0.5.**

As well as comparing a built system to the Carnot cycle COP for specific operating conditions, the SCOP for the Carnot cycle can also be calculated, if the heat-source and heat-sink temperature estimates for the season are available. The thermodynamic efficiency relative to the Carnot cycle can be calculated using the SCOP value.

**The recommended performance benchmark for the SCOP is a thermodynamic efficiency relative to the Carnot cycle of at least 0.5.**

When the heat source for a process-heating application is not ambient, the COP may not vary much throughout the year.

When there are several HTHP configurations or technologies to choose from, and they all comply with the recommended performance benchmarks, comparing each option's thermodynamic efficiency relative to the Carnot cycle is a reasonable way to compare their energy-efficiency. However, there may be other factors that will guide the choice, such as capital cost, maintenance cost and requirements, and refrigerant selection.



## APPENDIX A – ADDITIONAL INFORMATION ON REFRIGERANTS

### A1 Environmental issues

There are several environmental issues associated with releasing refrigerants into the atmosphere.

#### A1.1 Ozone depletion

The previous generation of refrigerants were made up of chlorofluorocarbons (CFCs) and hydrochlorofluorocarbons (HCFCs). These have been phased out, as they deplete the ozone layer. This phase-out was facilitated by the Montreal Protocol, which is an international agreement that New Zealand is party to.

A refrigerant's ability to deplete the ozone is represented by its ozone depletion potential (ODP). A refrigerant's ODP is measured relative to the ODP of R11. In general, newer refrigerants do not deplete the ozone.

#### A1.2 Climate change

HFCs are the most common type of refrigerant currently used, but they are being phased out as they are potent GHGs. A refrigerant's ability to act as a GHG is measured by its GWP. GWP is measured relative to CO<sub>2</sub> in mass equivalents of CO<sub>2</sub> (CO<sub>2</sub>eq). The Kigali Amendment to the Montreal Protocol requires party nations to limit their use of certain HFCs. This means they are likely to become more expensive and less readily available.

#### A1.3 Environmental contamination

Many refrigerants, such as HFCs and HFOs, can be classified as poly- or per-fluorinated alkyl substances (PFAS), or they degrade into PFAS. These substances are a concern, because they are chemically stable and, therefore, persist in the environment.

### A2 Refrigerant safety

When a refrigerant is being selected, some safety concerns need to be considered. Refrigerant safety classifications have two components:

- (t) A letter component denotes whether the refrigerant is toxic (A = low or no toxicity; B = high toxicity); and
- (u) A number component denotes how flammable the refrigerant is (1 = no flame propagation at standard pressure and 60°C; 2 = flammable; 3 = highly flammable).

Most common refrigerants are A1 (not flammable or toxic), but they generally have high GWP. Most refrigerants with low GWP are flammable, to some degree.

The A2L class was introduced to identify refrigerants with lower toxicity and lower flammability than A2. While their flammability is lower, they still require more safety controls than A1 refrigerants. These requirements (such as, restrictions on charge size) are specified in, for example, EN 378.

HC refrigerants are A3 class, which means they are highly flammable and need more safety controls than A2L refrigerants. These controls include lower charge limits.

Some refrigerants (such as CO<sub>2</sub> refrigerants) also need a high-pressure system to operate. Pressure vessels for refrigerants shall comply with AS 1210 or an international code approved under AS 1210 (such as *Boiler and pressure vessel code*, Section VIII; BS EN 13445; or PD 5500).

### A3 Refrigerant types

#### A3.1 Hydrofluorocarbons

HFCs are the most common type of refrigerant currently used. The Kigali Amendment to the Montreal Protocol requires party nations to limit their use of certain HFCs, due to their high GWP. This means they are likely to become more expensive and less readily available.

#### A3.2 Hydrocarbons

HCs are derived from common natural gases, like propane and butane. HCs have very low GWP. However, they are highly flammable, so they present a safety risk that shall be managed.

#### A3.3 Natural refrigerants

Natural refrigerants are a broad class that covers HCs, CO<sub>2</sub> and ammonia. These refrigerants have very low GWP, but each has other safety hazards. HCs are highly flammable; CO<sub>2</sub> requires a high-pressure system; and ammonia is toxic.

#### A3.4 Hydrofluoroolefins

HFOs are emerging as a replacement for HFCs. In general, HFOs have very low GWP, but they are moderately flammable. They also are a class of PFAS that is suspected of indirectly contaminating the environment, as they can degrade into HFCs and polyfluorinated acids.

#### A3.5 Chlorofluorocarbons and hydrochlorofluorocarbons

CFCs and HCFCs are a previous generation of refrigerant. The Montreal Protocol has phased out their use, due to their propensity to deplete the ozone layer.

### A4 Refrigerant leaks

#### A4.1 General

In a sealed HTHP unit, the refrigerant stays in the system and is not consumed as the unit is used. Refrigerants may escape to the atmosphere if the system leaks, or when the product reaches the end of its life.

#### A4.2 Leak minimisation

Refrigerant can leak if pipes, or other components, fracture or corrode. Follow these steps to minimise the risk of leaks:

- (v) Keep records of refrigerant levels and any top-ups, so that abnormal losses can be identified, investigated, and fixed;
- (w) Regularly inspect the physical integrity of the system; and
- (x) Check and top-up refrigerant levels during ongoing maintenance.

#### A4.3 Leakage by handling

Follow these steps to ensure that refrigerants are not released into the atmosphere when a system is being built, maintained, or decommissioned:

- (y) Ensure an appropriately qualified technician carefully handles the refrigerant, using industry-agreed practices, to minimise the risk of it being accidentally released into the atmosphere; and
- (z) Ensure an appropriately qualified technician recovers the refrigerant when a product reaches the end of its life, and provides the refrigerant to a specialist organisation to be destroyed or reused.

### A5 Charge minimisation

Charge minimisation is the practice of designing a heat-pump system to use as little refrigerant as possible, to increase its efficiency. The practice also reduces the risks posed by hazardous refrigerants.

The refrigerant charge of two systems can be compared by the ratio of kilograms of refrigerant charge to kilowatts of heating provided ( $\text{kg}_{\text{refrigerant}}/\text{kW}_{\text{heating}}$ ).

Another way to measure the environmental impact of the refrigerant charge for the HTHP unit is the ratio of kilograms of CO<sub>2</sub>eq of refrigerant charge to kilowatts of heating provided ( $\text{kg}_{\text{CO}_2\text{eq}}/\text{kW}_{\text{heating}}$ ). The kilograms of CO<sub>2</sub>eq is found by multiplying the refrigerant's GWP by the unit's charge size of the unit.

With both measures, take care when comparing systems that use refrigerants with different safety requirements (see ASHRAE safety groups, Table 1).

**Table A1 – HTHP refrigerant types as listed in ISO 817**

Type	Refrigerant	Chemical formula	Tc <sup>e</sup> (°C)	Pc <sup>f</sup> (bar)	TBP <sup>g</sup> (°C)	ODP <sup>h</sup>	GWP <sup>i</sup>	SG <sup>j</sup>
HFC <sup>a</sup>	R32	CH <sub>2</sub> F <sub>2</sub>	78.1	57.8	-52	0	677	A2L
	R152a	CH <sub>3</sub> CHF <sub>2</sub>	113.3	45.2	-24	0	138	A2
	R227ea	CF <sub>3</sub> CHFCF <sub>3</sub>	101.8	29.3	-16	0	3350	A1
	R245fa	CF <sub>3</sub> CH <sub>2</sub> CHF <sub>2</sub>	154.1	36.4	15	0	858	B1
	R134a	CH <sub>2</sub> FCF <sub>3</sub>	101.1	40.6	-26	0	1300	A1
	R410a	(50%) CH <sub>2</sub> F <sub>2</sub>	72.6	49.0	-51	0	1924	A1

		(50%) CHF <sub>2</sub> CF <sub>3</sub>						
HFO <sup>b</sup>	R1234ze(E)	CF <sub>3</sub> CH=CHF	109.4	36.4	-19	0	<1	A2L
	R1234yf	CF <sub>3</sub> CF=CH <sub>2</sub>	94.7	33.8	-30	0	<1	A2L
	R1336mzz(E)	CF <sub>3</sub> CH=CHCF <sub>3</sub>	137.7	31.5	8	0	18	A1
	R1336mzz(Z)	CF <sub>3</sub> CH=CHCF <sub>3</sub>	171.3	29.0	33	0	9	A1
HCFO <sup>c</sup>	R1224yd(Z)	CHCl=CFCF <sub>3</sub>	156.0	33.4	15	0.00012	4	A1
	R1233zd(E)	CHCl=CHCF <sub>3</sub>	165.6	35.7	18	0.000134	5	A1
HC <sup>d</sup>	R600	CH <sub>3</sub> CH <sub>2</sub> CH <sub>2</sub> CH <sub>3</sub>	152.0	38.0	0	0	4	A3
		(butane)						
	R600a	CH(CH <sub>3</sub> ) <sub>2</sub> CH <sub>3</sub>	134.7	36.3	-12	0	3	A3
		(iso-butane)						
	R290	CH <sub>3</sub> CH <sub>2</sub> CH <sub>3</sub>	96.7	42.5	-42	0	3	A3
		(propane)						
	R601	CH <sub>3</sub> (CH <sub>2</sub> )CH	196.6	33.6	36	0	5	A3
		(pentane)						
Natural	R718	H <sub>2</sub> O	373.9	220.6	100	0	0	A1
		(water)						
	R717	NH <sub>3</sub>	132.3	113.3	-33	0	0	B2L
		(ammonia)						
	R744	CO <sub>2</sub>	31.0	73.8	-78	0	1	A1
		(carbon dioxide)						

## NOTE –

- HFC = hydrofluorocarbons
- HFO = hydrofluoroolefins
- HCFO = hydrochlorofluoroolefins
- HC = hydrocarbons
- T<sub>c</sub> = critical temperature (°C)
- P<sub>c</sub> = critical pressure (bar)
- T<sub>BP</sub> = boiling point at standard atmospheric pressure (°C)
- ODP = ozone depletion potential (calculated on the basis that R11 = 1.0)
- GWP = global warming potential (calculated for a 100-year time horizon on the basis that CO<sub>2</sub> = 1.0, AR4 and AR5 data where available)
- SG = safety group (ASHRAE standard 34) (A = low/no toxicity; B = highly toxic; 1 = no flame propagation at standard pressure and 60°C; 2L = lower flammability; 2 = flammable; 3 = highly flammable)

## APPENDIX B – MODIFICATION OF AS/NZS 5125 METHODOLOGY FOR HTHP GREATER THAN 15 KW

### B1 Lab testing

The methodology described in AS/NZS 5125 for commercial air- and water-source HTHPs can be modified by increasing the size of the water tank in proportion to the unit's heating capacity, or by selecting water-source temperatures that match the application's conditions. The storage tank shall contain at least 50 L/kW of rated unit capacity and shall be insulated with a known heat-loss coefficient.

AS/NZS 5125 involves measuring, under a range of standardised test conditions, the power input and thermal energy produced by the unit when it is coupled to a storage tank.

AS/NZS 4234 shall be used to estimate the unit's annual energy consumption and SCOP. Once the performance coefficients have been determined, by analysing the test results from the methodology in AS/NZS 5125 or an equivalent methodology, they can be entered into the heat-pump model of a thermal-simulation software package using AS/NZS 4234. The unit's energy use can then be compared with a reference heating system (for example, a boiler). The difference between the GHG emissions of two or more systems can be calculated using the carbon-emission factor for the energy that the system consumes.

Variable-speed HTHPs shall be tested in accordance with AS/NZS 5125, or an equivalent methodology for non-air-source systems, using a locked compressor speed.

### B2 Ambient environmental testing

Units whose rated capacity is more than 15 kW at ambient condition 7°C/6°C (DB/WB), and whose water-outlet temperature is more than 50°C, can adopt these modifications to AS/NZS 5125, Appendix A:

- (aa) Data collected from outdoor testing can be used, if no direct or indirect radiation on the unit occurs that raises the surface temperature more than 5°C above the ambient temperature. The surface temperature shall be measured with a calibrated infrared thermometer from a 1 m distance;
- (bb) The ambient condition shall remain within 1°C of the nominal dry-bulb temperature during the test;
- (cc) The maximum ambient test condition shall be within 3°C of the maximum modelled ambient test conditions for the location;
- (dd) The minimum ambient test condition shall be no more than 10°C;
- (ee) At least four test conditions are tested, including a test with a relative humidity difference greater than 25% at the warmest condition tested. There is at least a 5°C ambient temperature difference between each of the four test conditions;
- (ff) immediately before and after the test, and during the test, the maximum wind speed at the unit shall be no more than 0.5 m/s;
- (gg) The tank may be unpressurised; and
- (hh) The minimum number of tank sensors shall be 10.

The requirements for measurement accuracy in AS/NZS 5125, Appendix A, clause A4 still apply. The low ambient test condition shall be applied to HTHP, and the frost penalty shall be determined in accordance with AS/NZS 5125.

The low ambient test condition includes reducing the average heating capacity due to accumulated frost on the evaporator coils. A frosting penalty can be determined by simulating the system's energy performance under non-frosting conditions, and comparing it with the system's actual performance once defrosting cycles are considered. It can be difficult for a test laboratory to maintain these low ambient test conditions throughout the test, especially with large-capacity units.

When the frosting penalty cannot be determined, a standardised penalty of 25% shall be applied to the lowest dry-bulb temperature that does not result in frost that persists for more than 10 minutes, with an inlet water temperature no higher than 15°C for potable-water-heating systems or 30°C for space-heating systems.

Variable-speed products may apply the frosting penalty separately, for different compressor speeds, since the lower the compressor speed, the lower the ambient condition can be for the suction line temperature to remain above -2°C. The frosting penalty shall be applied proportionally, for intermediate speeds tested.

## APPENDIX C – CALCULATION OF CARNOT COP

### C1 Carnot COP

The Carnot coefficient of performance ( $COP_{Carnot}$ ) is a theoretical limit to the COP that depends on the log mean temperature of the heat source ( $\bar{T}_{source}$ ) (°C) and the log mean temperature of the heat sink ( $\bar{T}_{sink}$ ) (°C) (see Equation C1). The Carnot COP cannot be achieved in practice, but is a useful benchmark to measure actual heat-pump systems against.

$$COP_{Carnot} = \frac{\bar{T}_{sink} + 273.15}{\bar{T}_{sink} - \bar{T}_{source}} \dots\dots\dots (Eq. C1)$$

Technically, the Carnot COP is used when the heat-source and heat-sink temperatures are constant. However, Equation C1 (with log mean temperatures for the heat source and heat sink) can be used when the temperature of the heat source or heat sink changes, which is common in the real world when using HTHP units.

The log mean temperature of a heat sink ( $\bar{T}_{sink}$ ) is calculated using Equation C2, when the heat sink enters the heat pump at an inlet temperature ( $T_{sink,inlet}$ ) (°C) and is heated to an exit temperature ( $T_{sink,exit}$ ) (°C).

$$\bar{T}_{sink} = \frac{T_{sink,exit} - T_{sink,inlet}}{\ln\left(\frac{T_{sink,exit} + 273.15}{T_{sink,inlet} + 273.15}\right)} - 273.15 \dots\dots\dots (Eq. C2)$$

The log mean temperature of a heat source ( $\bar{T}_{source}$ ) is calculated using Equation C3, when the heat source enters the heat pump at an inlet temperature ( $T_{source,inlet}$ ) (°C) and is cooled to an exit temperature ( $T_{source,exit}$ ) (°C).

$$\bar{T}_{source} = \frac{T_{source,exit} - T_{source,inlet}}{\ln\left(\frac{T_{source,exit} + 273.15}{T_{source,inlet} + 273.15}\right)} - 273.15 \dots\dots\dots (Eq. C3)$$

In this example, a heat pump heats hot water from 50°C to 85°C. Its heat source is ambient air, with an inlet temperature of 20°C. The flow rate is sufficient for the air temperature change to be small ( $\leq 1^\circ\text{C}$ ). The log mean temperature of the hot water (the heat sink) is calculated using Equation C4.

$$\bar{T}_{sink} = \frac{T_{sink,exit} - T_{sink,inlet}}{\ln\left(\frac{T_{sink,exit} + 273.15}{T_{sink,inlet} + 273.15}\right)} - 273.15 = \frac{85 - 50}{\ln\left(\frac{85 + 273.15}{50 + 273.15}\right)} - 273.15 = \frac{35}{0.10284} - 273.15 = 67.2^\circ\text{C} \dots\dots\dots (Eq. C4)$$

As there is only a small change in the ambient-air (the heat source) temperature, the value of  $\bar{T}_{source}$  is taken to be 20°C (see Equation C5).

$$\bar{T}_{source} = 20.0^\circ\text{C} \dots\dots\dots (Eq. C5)$$

The Carnot COP for these conditions is calculated as shown in Equation C6.

$$COP_{Carnot} = \frac{\bar{T}_{sink} + 273.15}{\bar{T}_{sink} - \bar{T}_{source}} = \frac{67.2 + 273.15}{67.2 - 20.0} = 7.2 \dots\dots\dots (Eq. C6)$$

### C2 Thermodynamic efficiency relative to Carnot

The thermodynamic efficiency relative to Carnot ( $\eta_{Carnot}$ ) is the ratio of the COP of the real system to the Carnot COP ( $COP_{Carnot}$ ) (see Equation C7). It measures how closely the real system is performing to the theoretical maximum for the conditions.

$$\eta_{Carnot} = \frac{COP}{COP_{Carnot}} \dots\dots\dots (Eq. C7)$$